


Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>  
Installation type "B": free inlet, ducted outlet  
12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12

<b>Fan type:</b>	DAIN 10/8 XPL	<b>Motor code:</b>	2011002	<b>Motor T.H.:</b>	YES IN
<b>Test nr.:</b>	812, 826, 827	<b>Motor power [W]:</b>	245	<b>Capacitor [<math>\mu</math>F]:</b>	8
<b>Date:</b>	2014/09/04	<b>Motor poles:</b>	6	<b>Fan max. abs. current [A]:</b>	2.7
<b>Power supply[V]:</b>	230 1~	<b>Mot. prot. class:</b>	IP 20		
<b>Frequency [Hz]:</b>	50	<b>Mot. ins. class:</b>	F		

Fan ErP status: ErP 2015

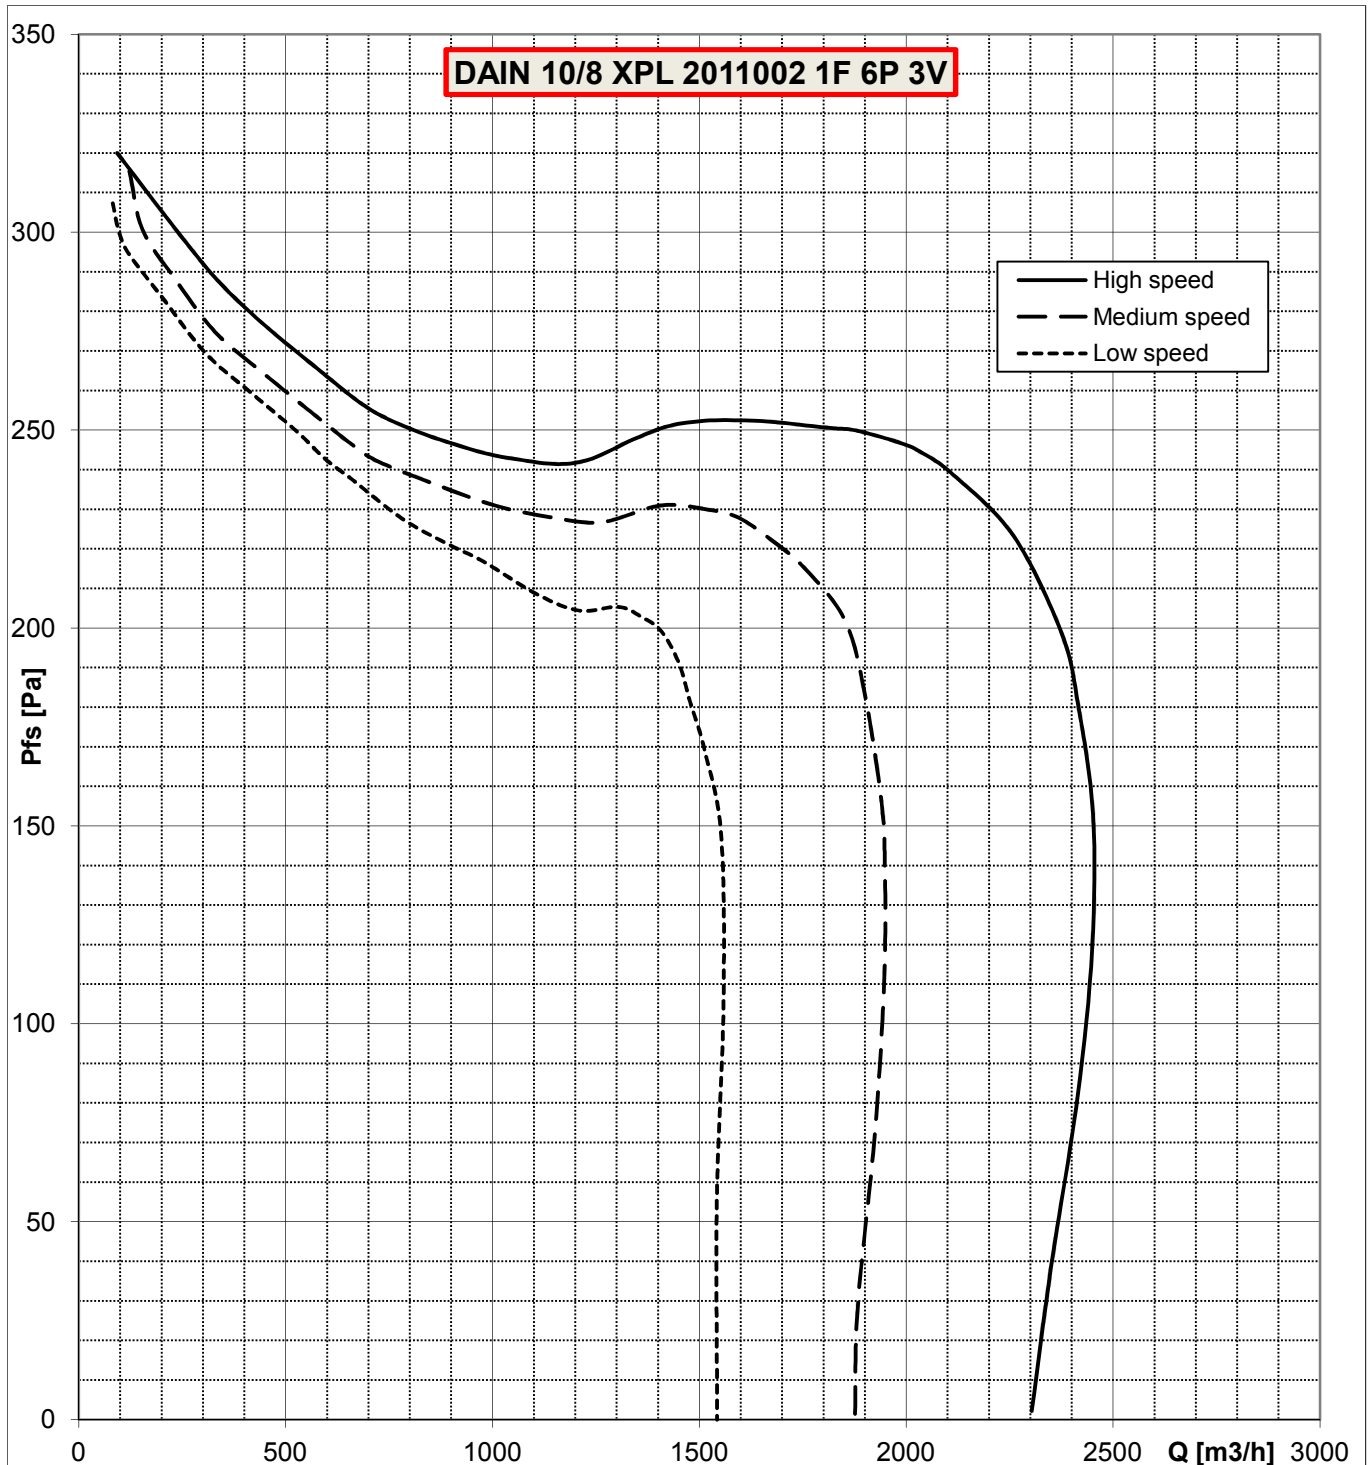

Data are not certified by AMCA