

Air density (γ): 1.20 kg/m³

Installation type "B": free inlet, ducted outlet


12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Fan type: DAIN 9/7 XPL2
Test nr.: 684
Date: 2014/06/18
Power supply[V]: 230 1~
Frequency [Hz]: 50

Motor code: 2011007
Motor power [W]: 420
Motor poles: 4
Mot. prot. class: IP44
Mot. ins. class: F

Motor T.H.: YES IN
Capacitor [μ F]: 8
Fan max. abs. current [A]: 4

Fan ErP status: ErP 2015

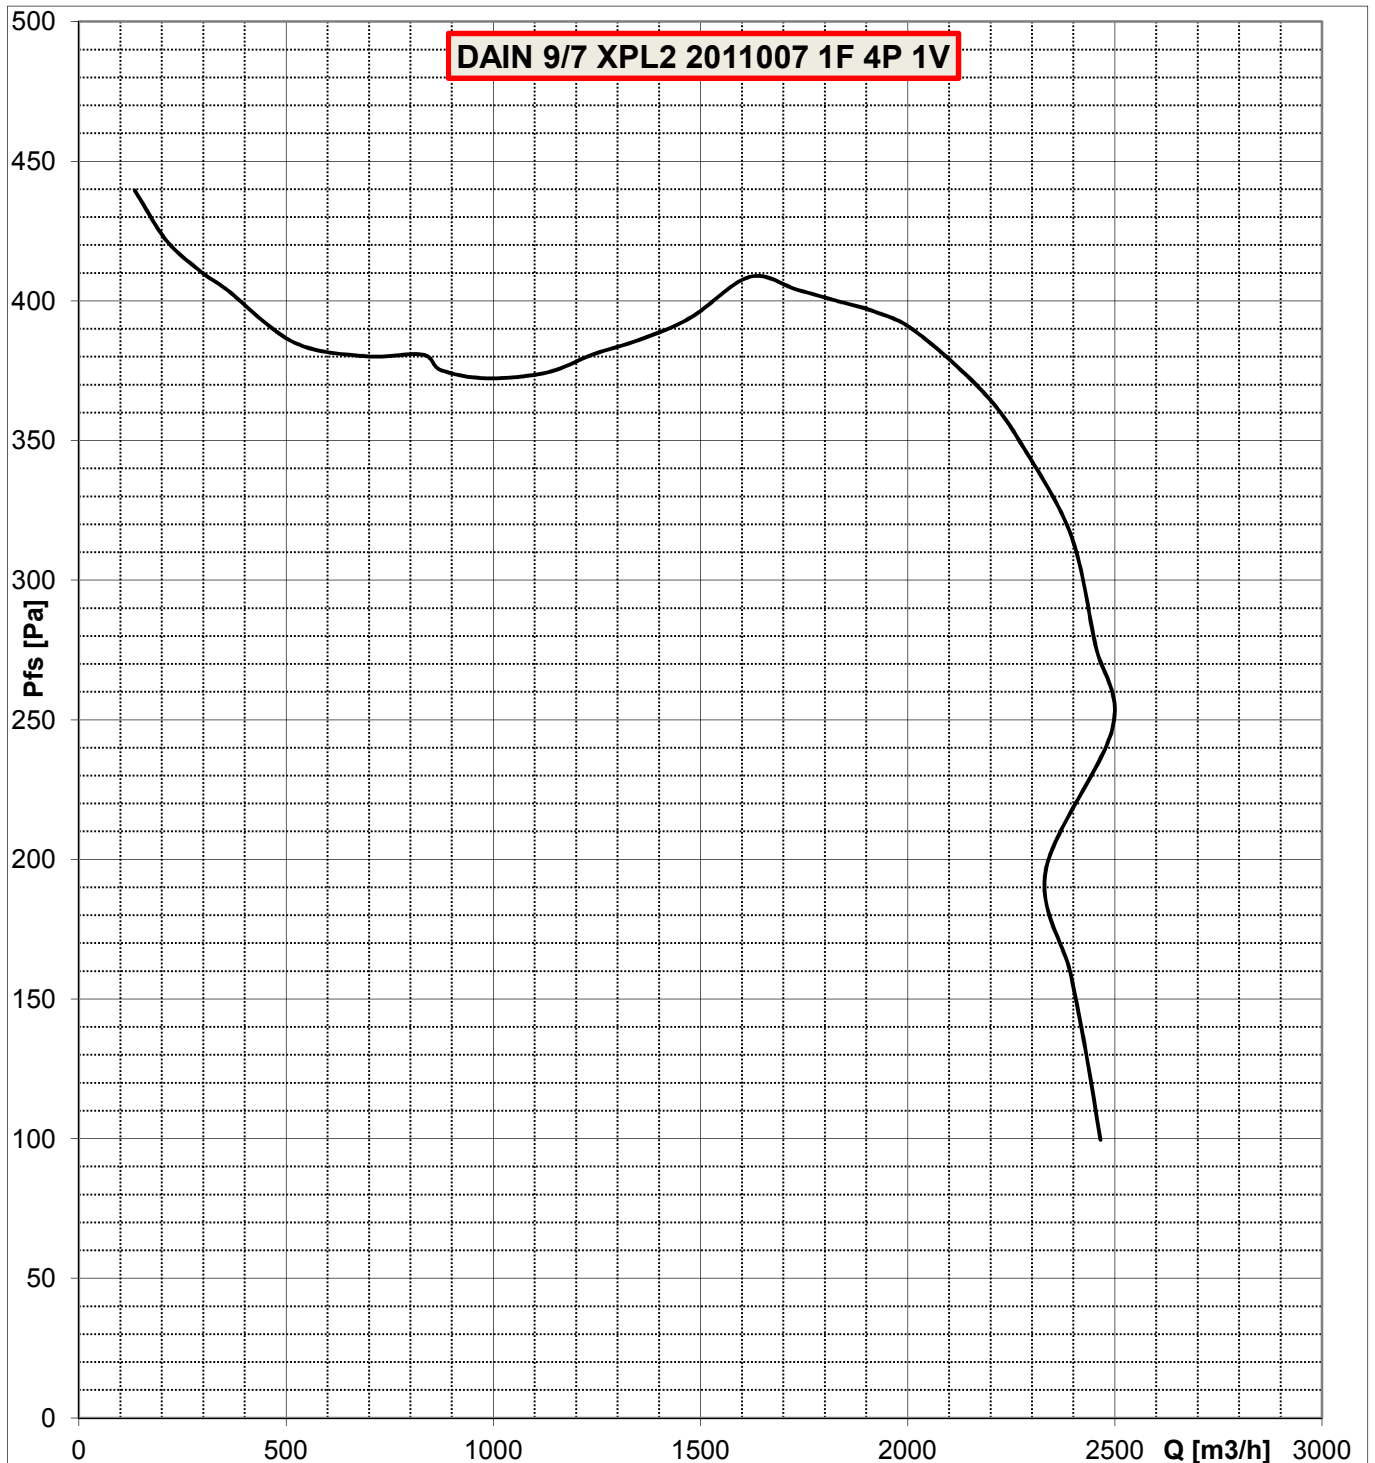

Data are not certified by AMCA