


Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Fan type:	DAIN 12/12 XPL	Motor code:	201100A	Motor T.H.:	YES IN
Test nr.:	965	Motor power [W]:	746	Capacitor [μF]:	20
Date:	2014/11/21	Motor poles:	6	Fan max. abs. current [A]:	9.4
Power supply[V]:	230 1~	Mot. prot. class:	IP44		
Frequency [Hz]:	50	Mot. ins. class:	F		

Fan ErP status: ErP 2015

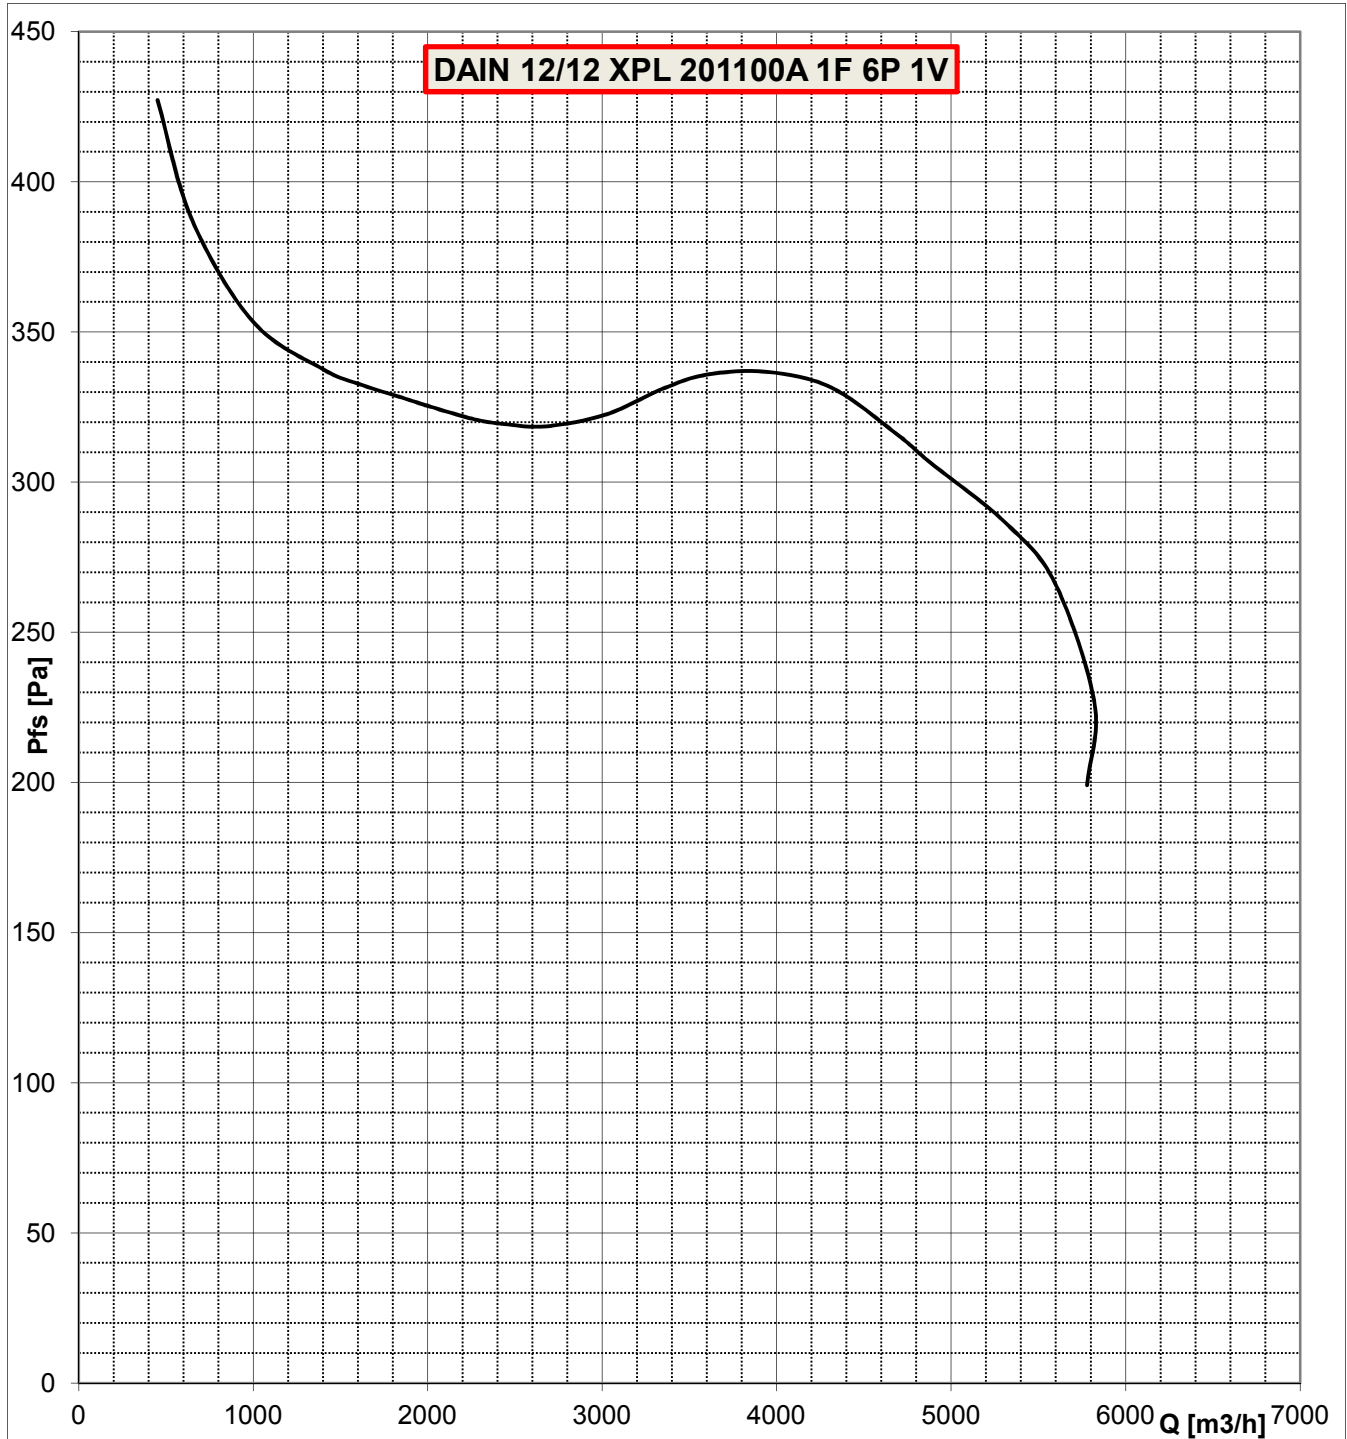

Data are not certified by AMCA