


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

| | | | | | |
|-------------------------|---------------|--------------------------|---------|---------------------------------------|--------|
| Fan type: | DAIN 9/7 XPL | Motor code: | 2011001 | Motor T.H.: | YES IN |
| Test nr.: | 690, 693, 697 | Motor power [W]: | 420 | Capacitor [μF]: | 12.5 |
| Date: | 2014/06/25 | Motor poles: | 4 | Fan max. abs. current [A]: | 4 |
| Power supply[V]: | 230 1~ | Mot. prot. class: | IP44 | | |
| Frequency [Hz]: | 50 | Mot. ins. class: | F | | |

Fan ErP status: ErP 2015

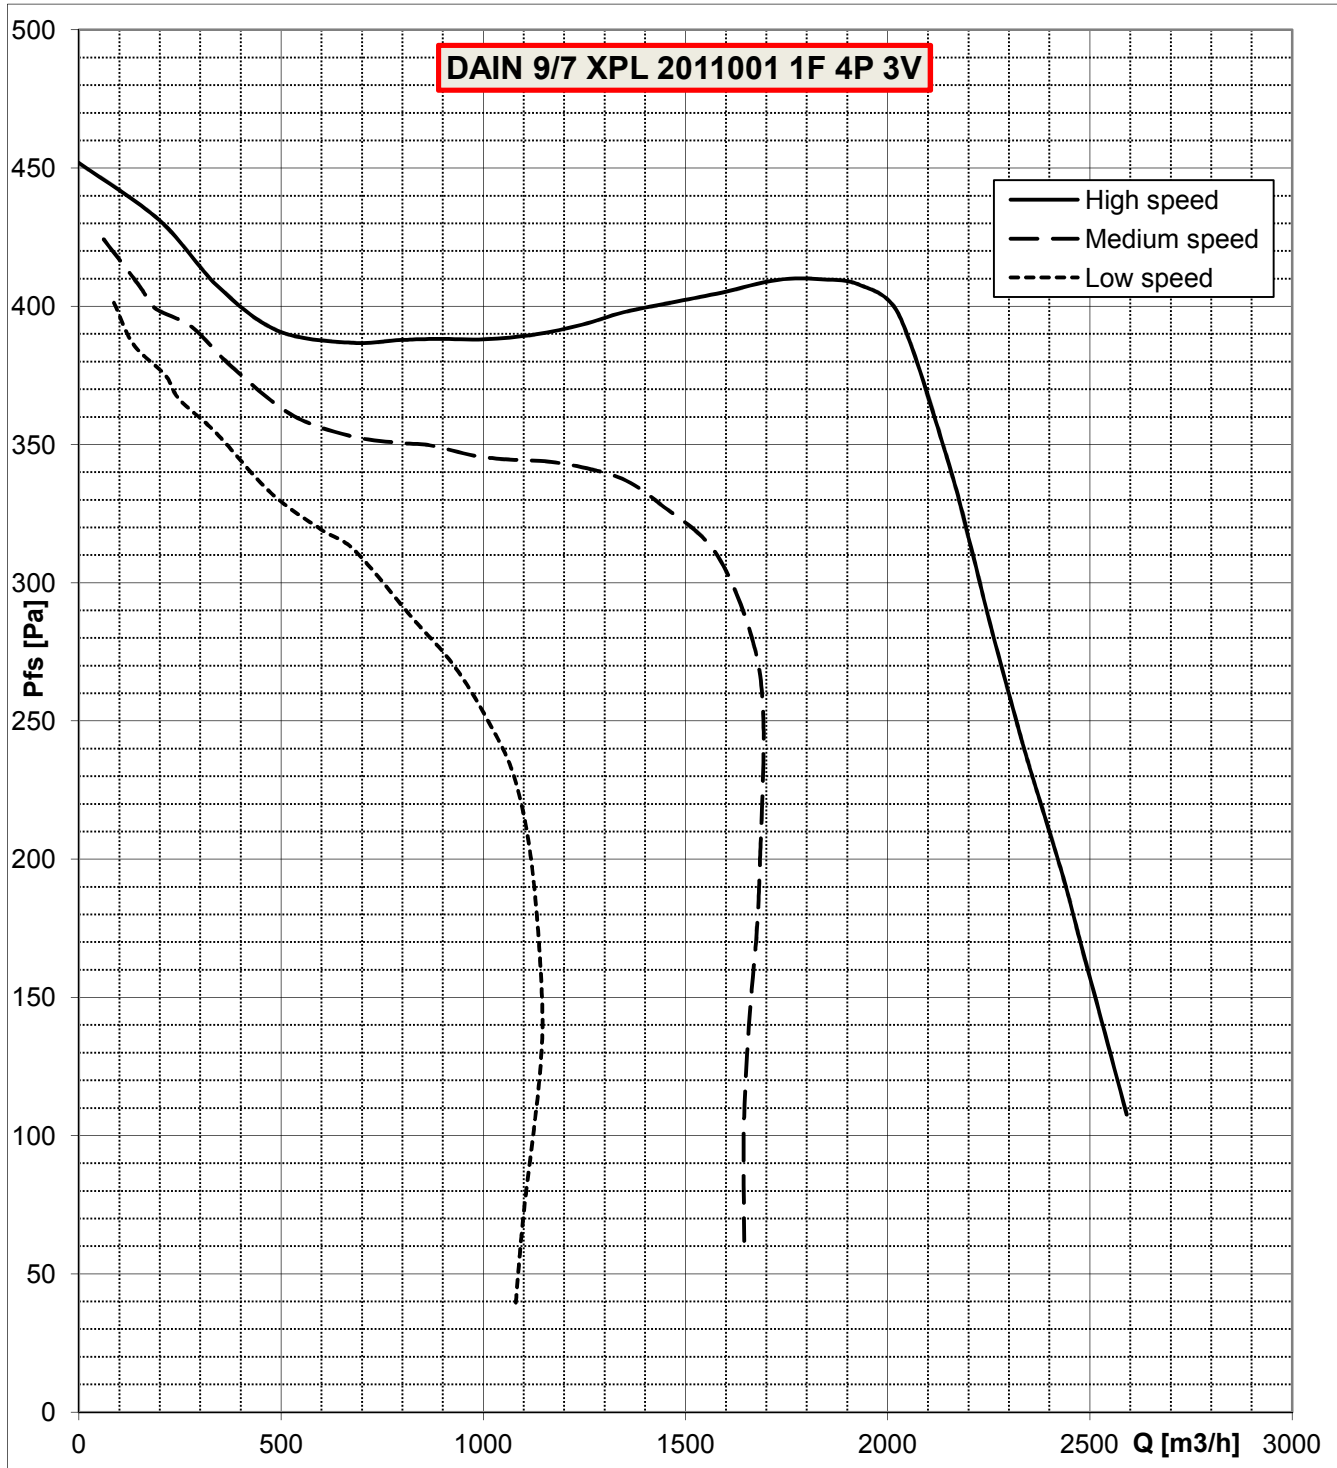

Data are not certified by AMCA