


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

| | | | | | |
|-------------------------|------------|--------------------------|--------------------|---------------------------------------|--------|
| Fan type: | DAIN 7/7 | Motor code: | MTR.4P.147.1V.IP55 | Motor T.H.: | YES IN |
| Test nr.: | 1506-1509 | Motor power [W]: | 147 | Capacitor [μF]: | 6.3 |
| Date: | 2015/09/17 | Motor poles: | 4 | Fan max. abs. current [A]: | 1.7 |
| Power supply[V]: | 230 1~ | Mot. prot. class: | IP 55 | | |
| Frequency [Hz]: | 60 | Mot. ins. class: | F | | |

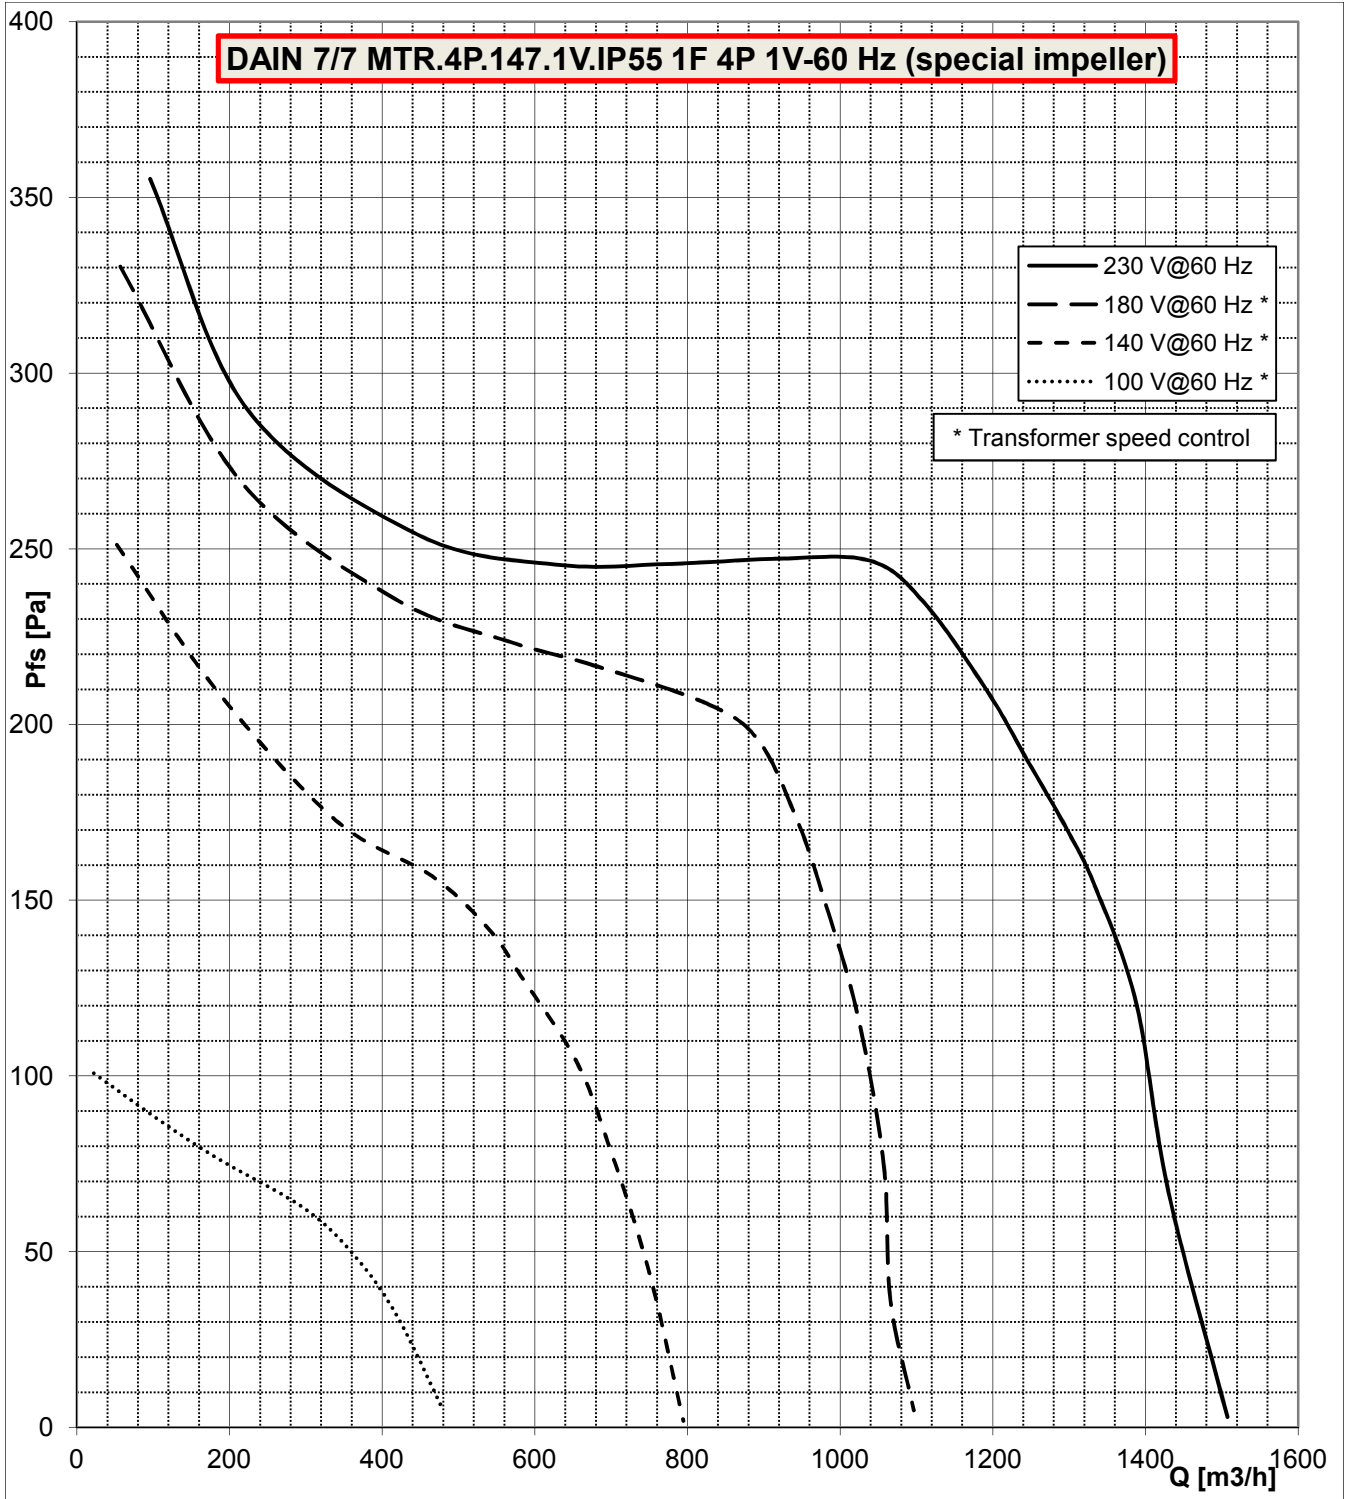

Data are not certified by AMCA