


Air density (γ): 1.20 kg/m³
Installation type "B": free inlet, ducted outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Fan type:	DAIN 9/7 XPL3	Motor code:	201100S	Motor T.H.:	YES OUT
Test nr.:	1372	Motor power [W]:	420	Capacitor [μ F]:	-
Date:	2015/06/30	Motor poles:	4	Fan max. abs. current [A]:	3.3/1.9
Power supply[V]:	230/400	Mot. prot. class:	IP55		
Frequency [Hz]:	50	Mot. ins. class:	F		

Fan ErP status: ErP 2015

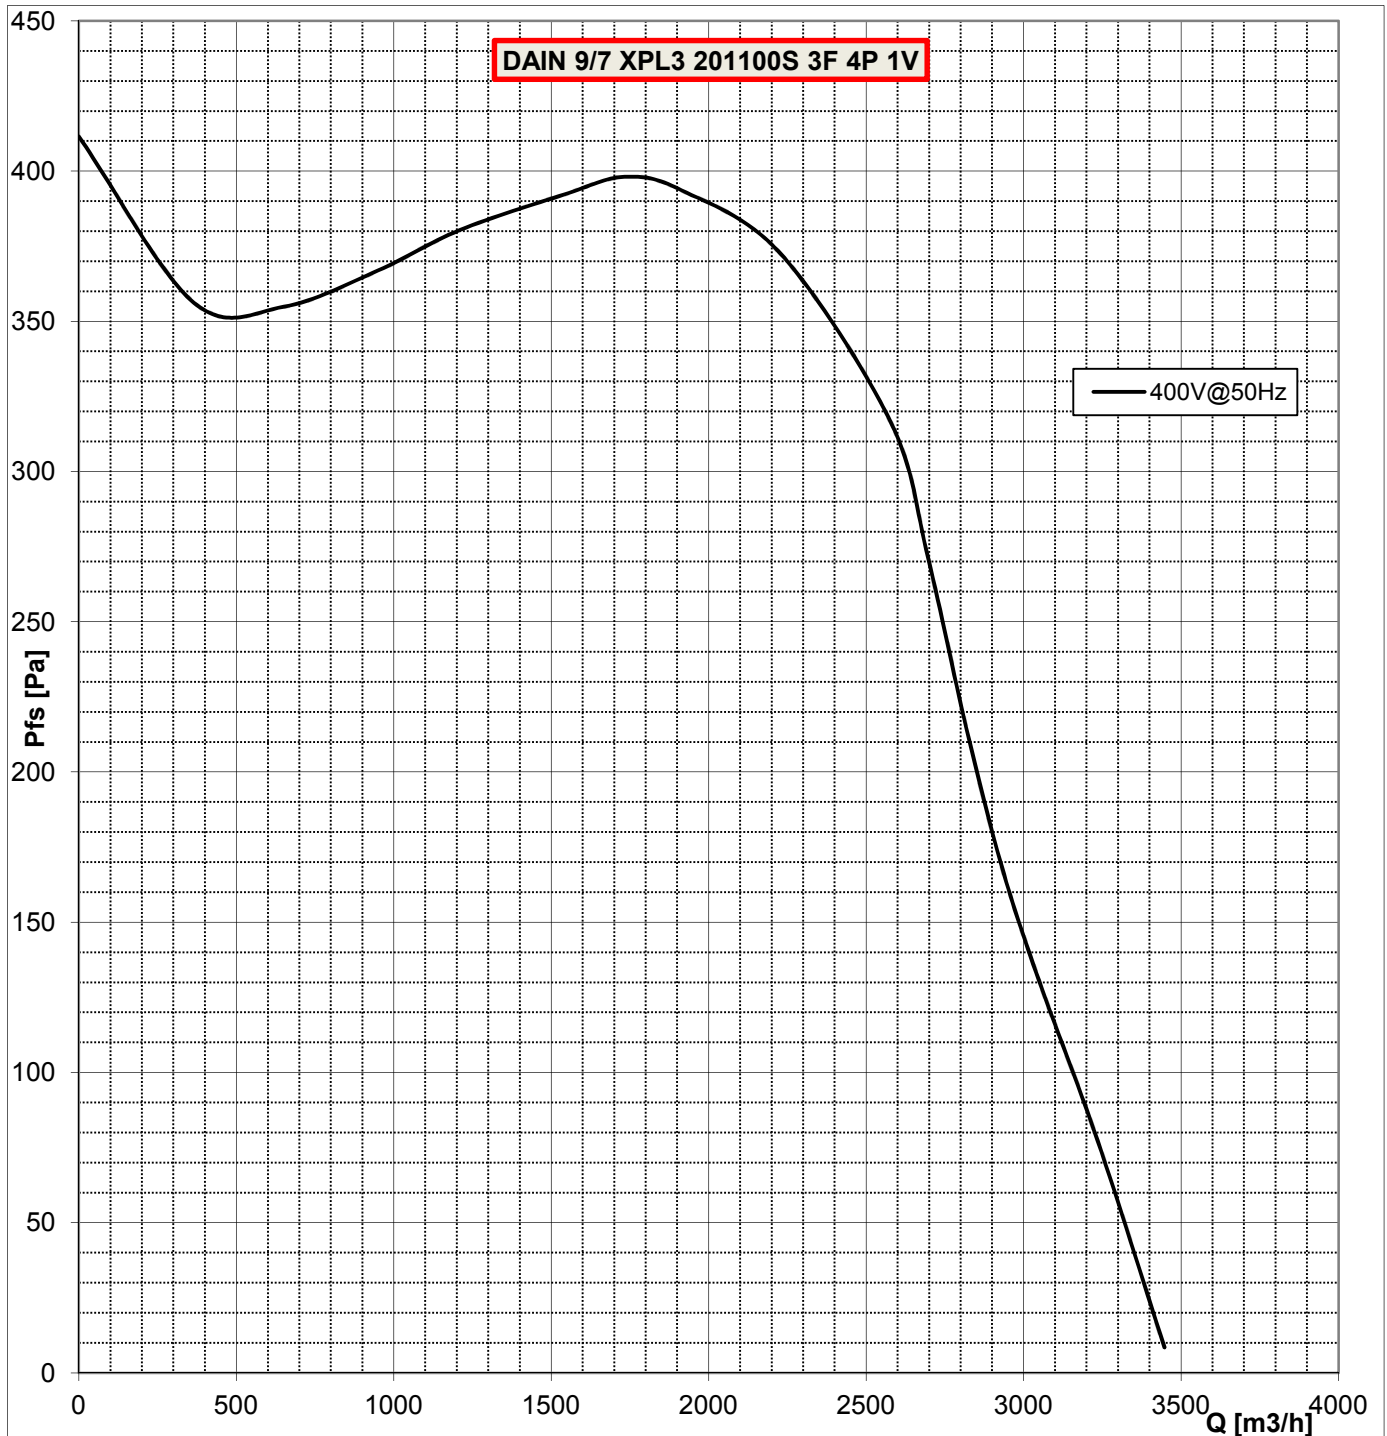

Data are not certified by AMCA