


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free-field inlet side Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	DAIN 12/9 XPL3	Motor code:	201100V	Motor T.H.:	YES OUT
Test nr.:	2965	Motor power [W]:	1500	Capacitor [μF]:	-
Date:	2018/07/03	Motor poles:	4	Fan max. abs. current [A]:	6,5/11,2
Power supply[V]:	400/230 3~	Mot. prot. class:	IP20		
Frequency [Hz]:	50	Mot. ins. class:	F		

Fan ErP status: ErP 2015

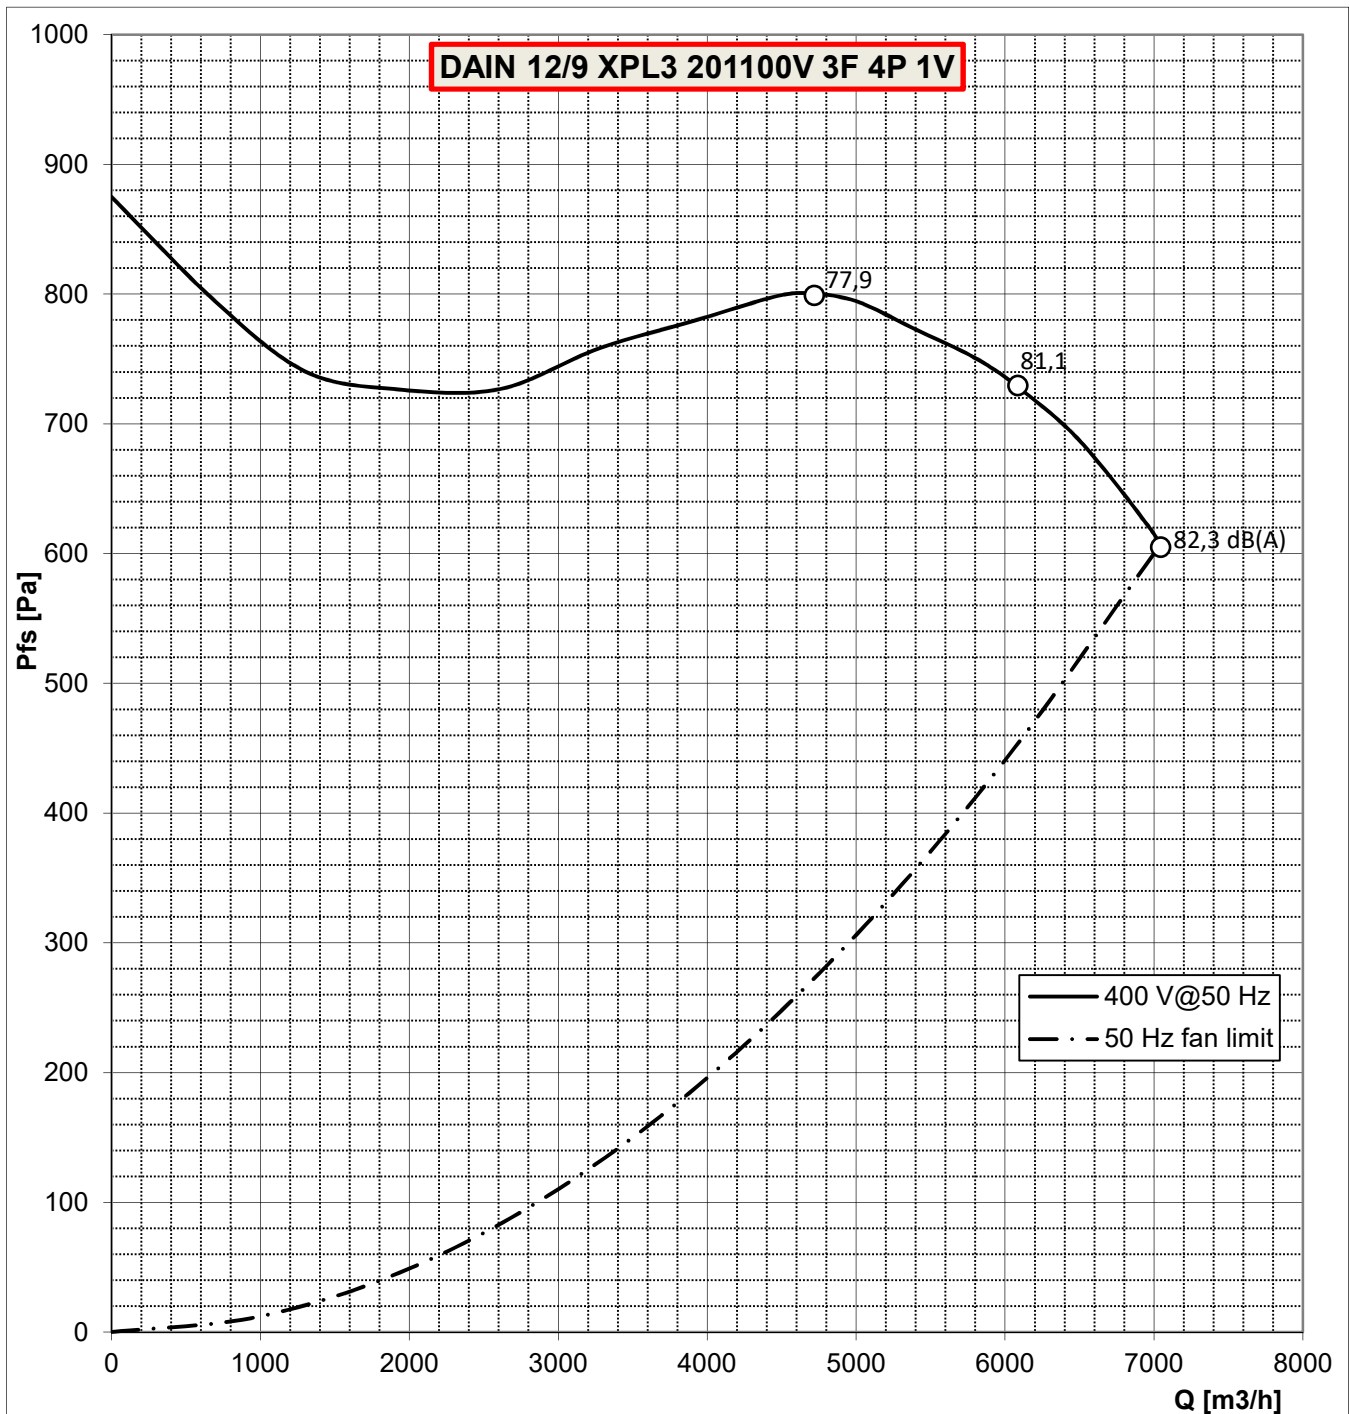

Data are not certified by AMCA