


Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>  
 Installation type "B": free inlet, ducted outlet  
 12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12  
 Inlet side Lp(A) measurements at 1 m according to ISO 3746:2011

|                         |                 |                          |         |                                       |          |
|-------------------------|-----------------|--------------------------|---------|---------------------------------------|----------|
| <b>Fan type:</b>        | DAIN 12/12 XPL2 | <b>Motor code:</b>       | 201100V | <b>Motor T.H.:</b>                    | YES OUT  |
| <b>Test nr.:</b>        | 2578            | <b>Motor power [W]:</b>  | 1500    | <b>Capacitor [<math>\mu</math>F]:</b> | -        |
| <b>Date:</b>            | 2017/09/19      | <b>Motor poles:</b>      | 4       | <b>Fan max. abs. current [A]:</b>     | 6.7/11.6 |
| <b>Power supply[V]:</b> | 400/230 3~      | <b>Mot. prot. class:</b> | IP20    |                                       |          |
| <b>Frequency [Hz]:</b>  | 50              | <b>Mot. ins. class:</b>  | F       |                                       |          |

Fan ErP status: ErP 2015

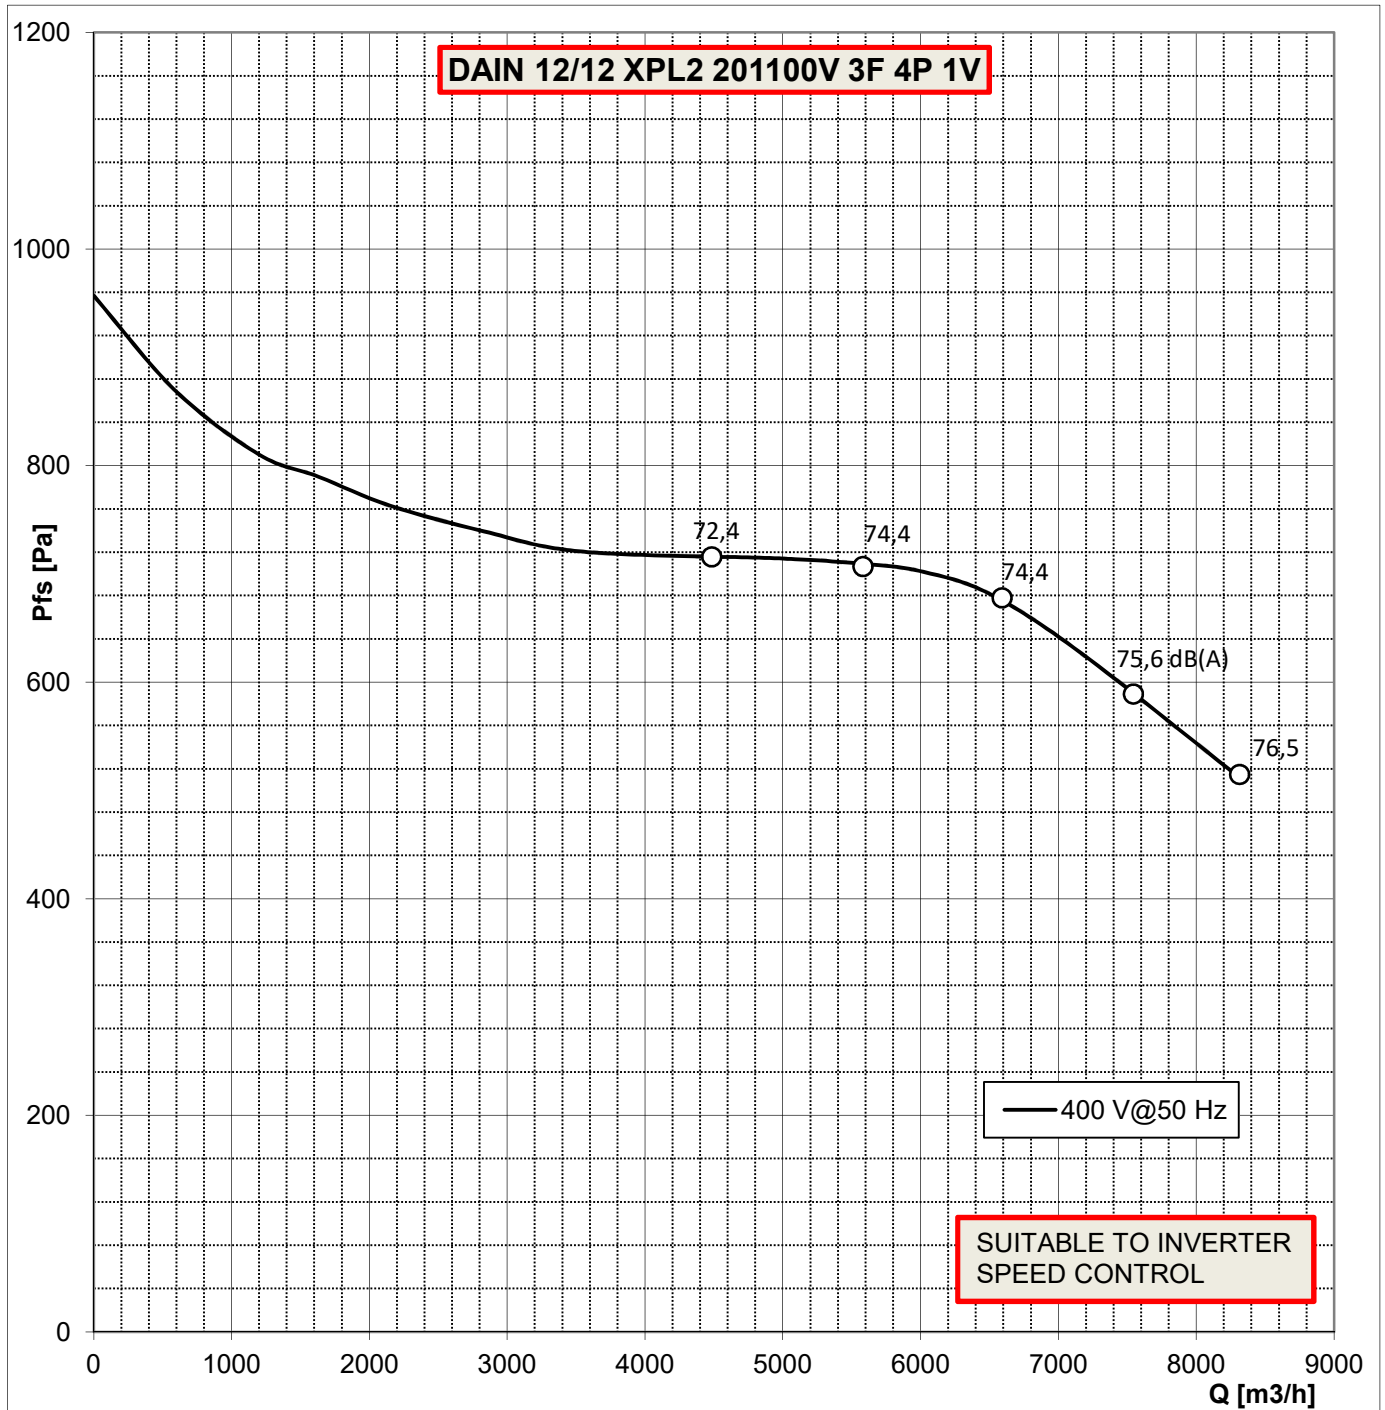

Data are not certified by AMCA