


Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>  
 Installation type "B": free inlet, ducted outlet  
 12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12

**Fan type:** DAIN 10/10 XPL2  
**Test nr.:** 1269, 1275, 1276, 1277  
**Date:** 2015/04/28  
**Power supply[V]:** 230 1~  
**Frequency [Hz]:** 50

**Motor code:** MTR.4P.550.1V  
**Motor power [W]:** 550  
**Motor poles:** 4  
**Mot. prot. class:** IP 44  
**Mot. ins. class:** F

**Motor T.H.:** YES IN  
**Capacitor [ $\mu$ F]:** 12.5  
**Fan max. abs. current [A]:** 6

Fan ErP status: ErP 2015

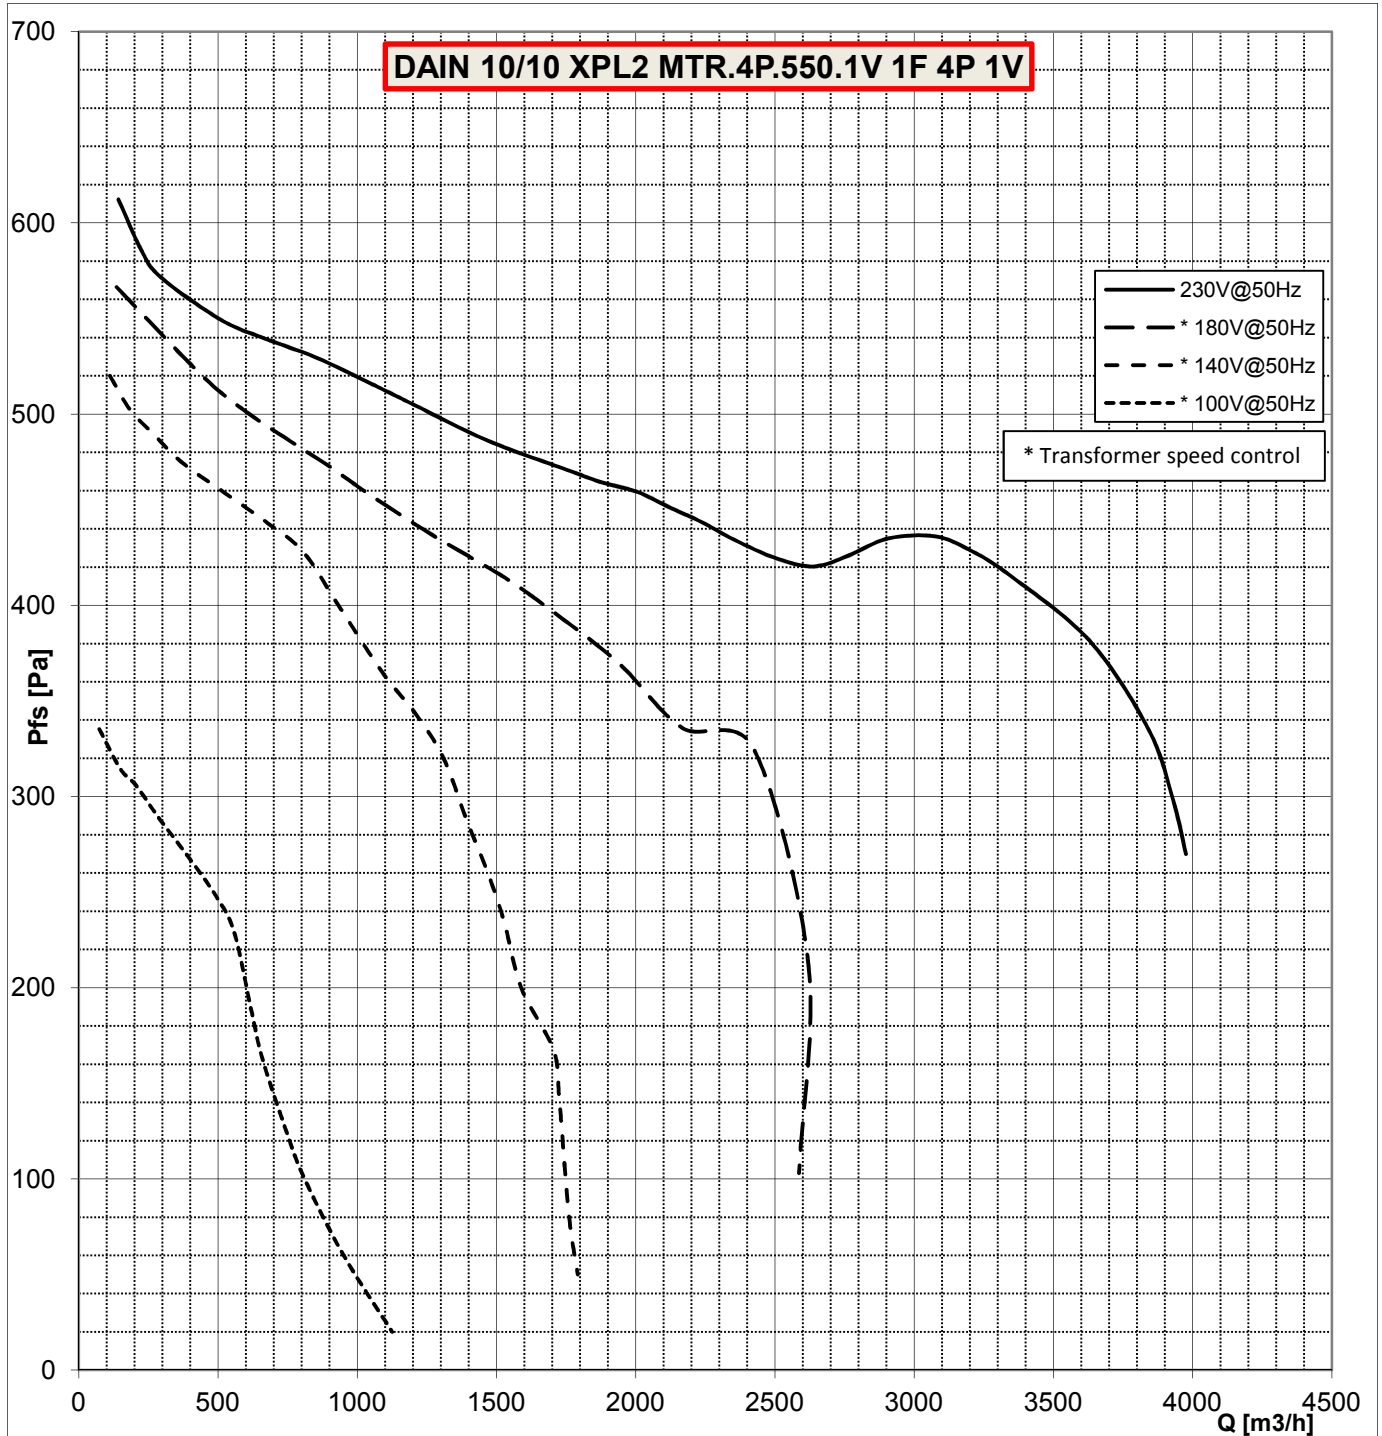

Data are not certified by AMCA