

Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>


Installation type "B": free inlet, ducted outlet

12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12

Free field inlet side Lp(A) measurements at 1 m according to ISO 3746:2011

<b>Fan type:</b>	DAIN 12/12 XPL3	<b>Motor code:</b>	2011015	<b>Motor T.H.:</b>	YES-OUT
<b>Test nr.:</b>	1988, 1989	<b>Motor power [W]:</b>	1100	<b>Capacitor [<math>\mu</math>F]:</b>	-
<b>Date:</b>	2016/09/13	<b>Motor poles:</b>	6	<b>Fan max. abs. current [A]:</b>	5,0/2,4
<b>Power supply[V]:</b>	400 / 400 3~	<b>Mot. prot. class:</b>	IP55		
<b>Frequency [Hz]:</b>	50	<b>Mot. ins. class:</b>	F		

Fan ErP status: ErP 2015

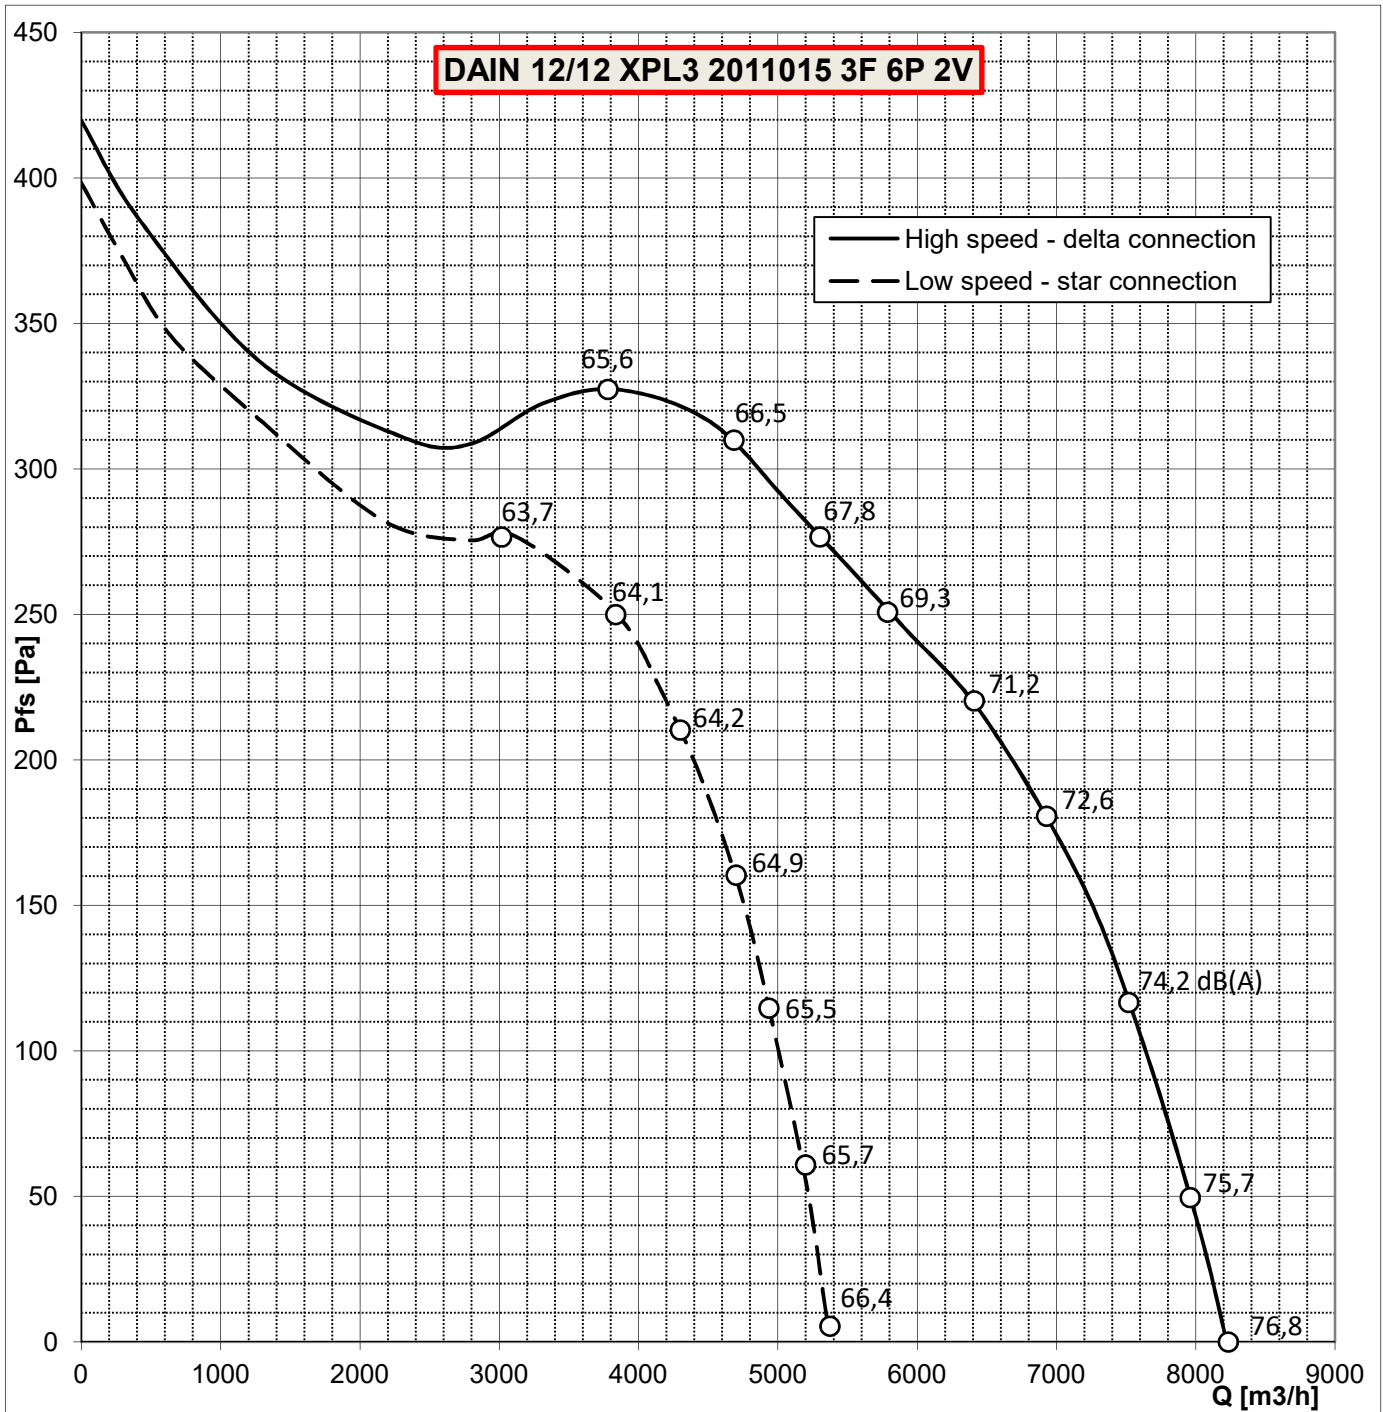

Data are not certified by AMCA