


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free field inlet side Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	DAIN 10/10 XPL	Motor code:	201101P	Motor T.H.:	YES IN
Test nr.:	2749 – 2751	Motor power [W]:	750	Capacitor [μF]:	20
Date:	2018/02/13	Motor poles:	4	Fan max. abs. current [A]:	9,6
Power supply[V]:	230 1~	Mot. prot. class:	IP20		
Frequency [Hz]:	50	Mot. ins. class:	F		

Fan ErP status: ErP 2015

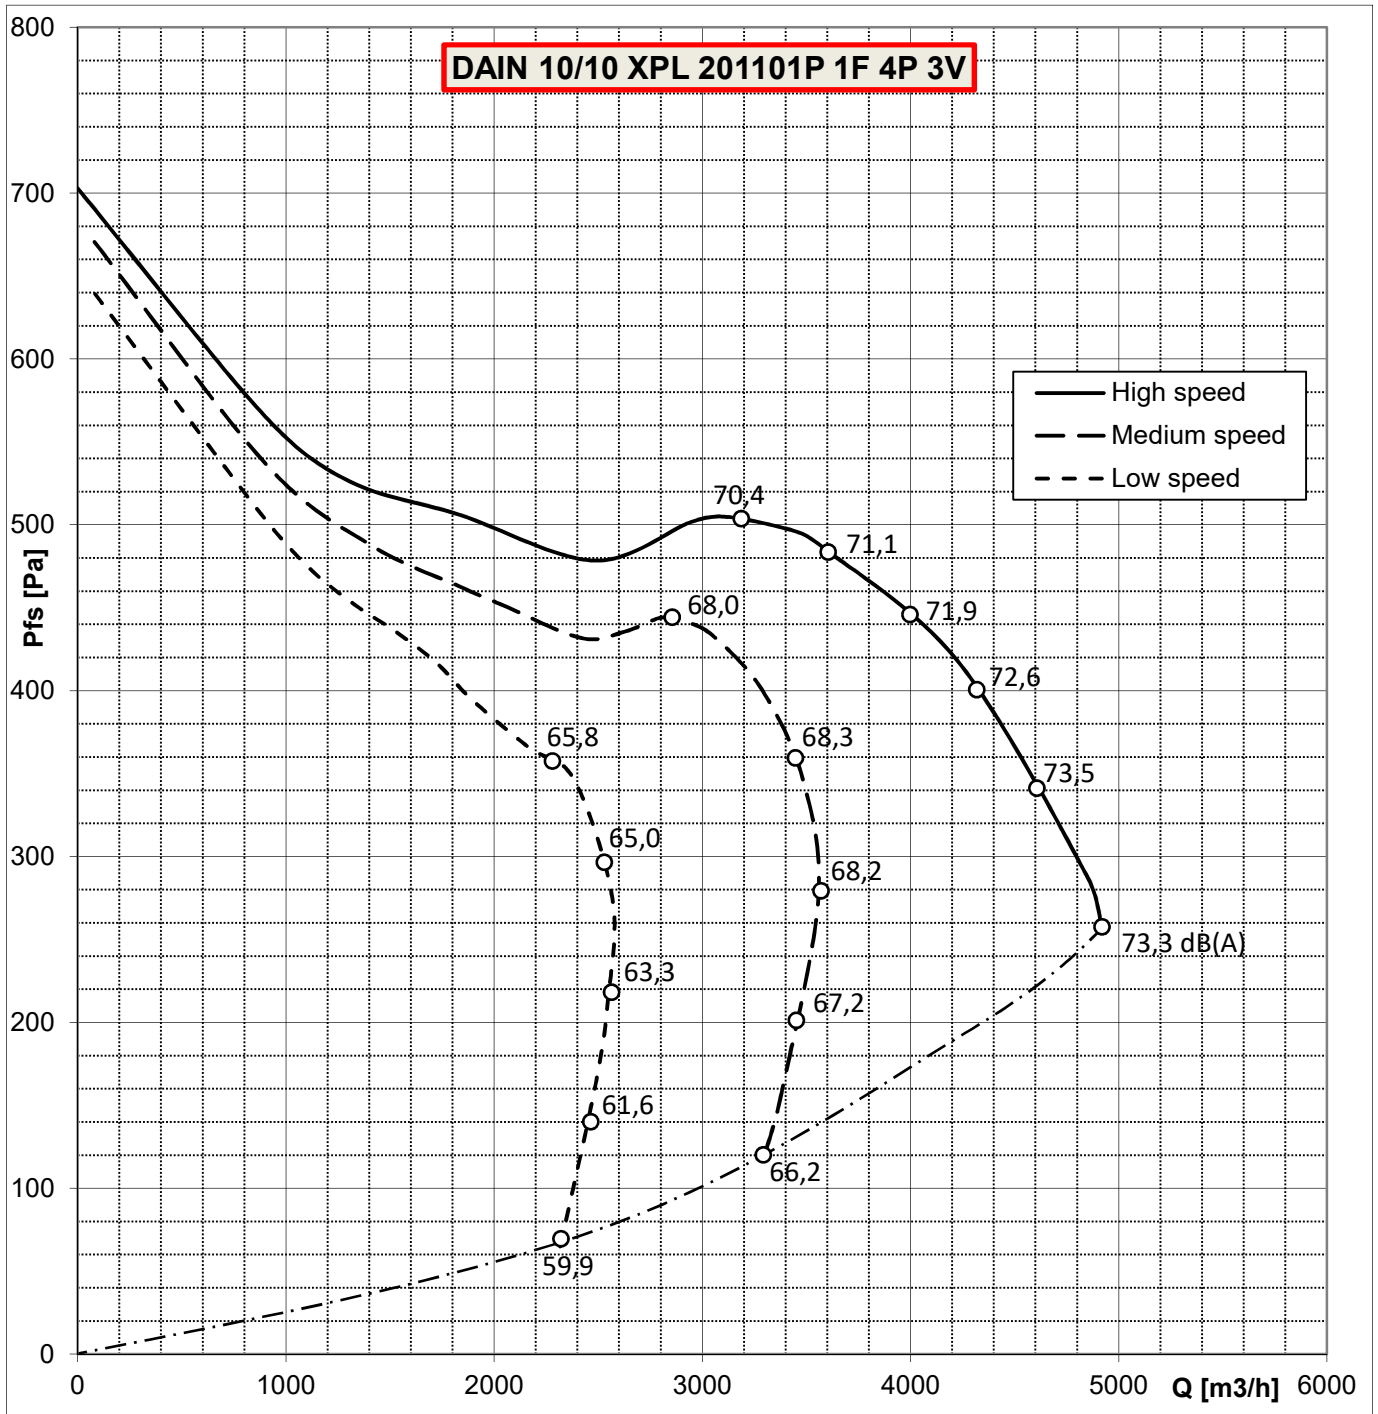

Data are not certified by AMCA