


Air density (γ): 1.20 kg/m³

Installation type "B": free inlet, ducted outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Fan type:	DAIN 9/9 R2 XPL	Motor code:	2011007	Motor T.H.:	YES IN
Test nr.:	1348, 1349	Motor power [W]:	420	Capacitor [μF]:	8
Date:	2015/06/16	Motor poles:	4	Fan max. abs. current [A]:	4
Power supply[V]:	230 1~	Mot. prot. class:	IP 44		
Frequency [Hz]:	50	Mot. ins. class:	F		

Fan ErP status: ErP 2015

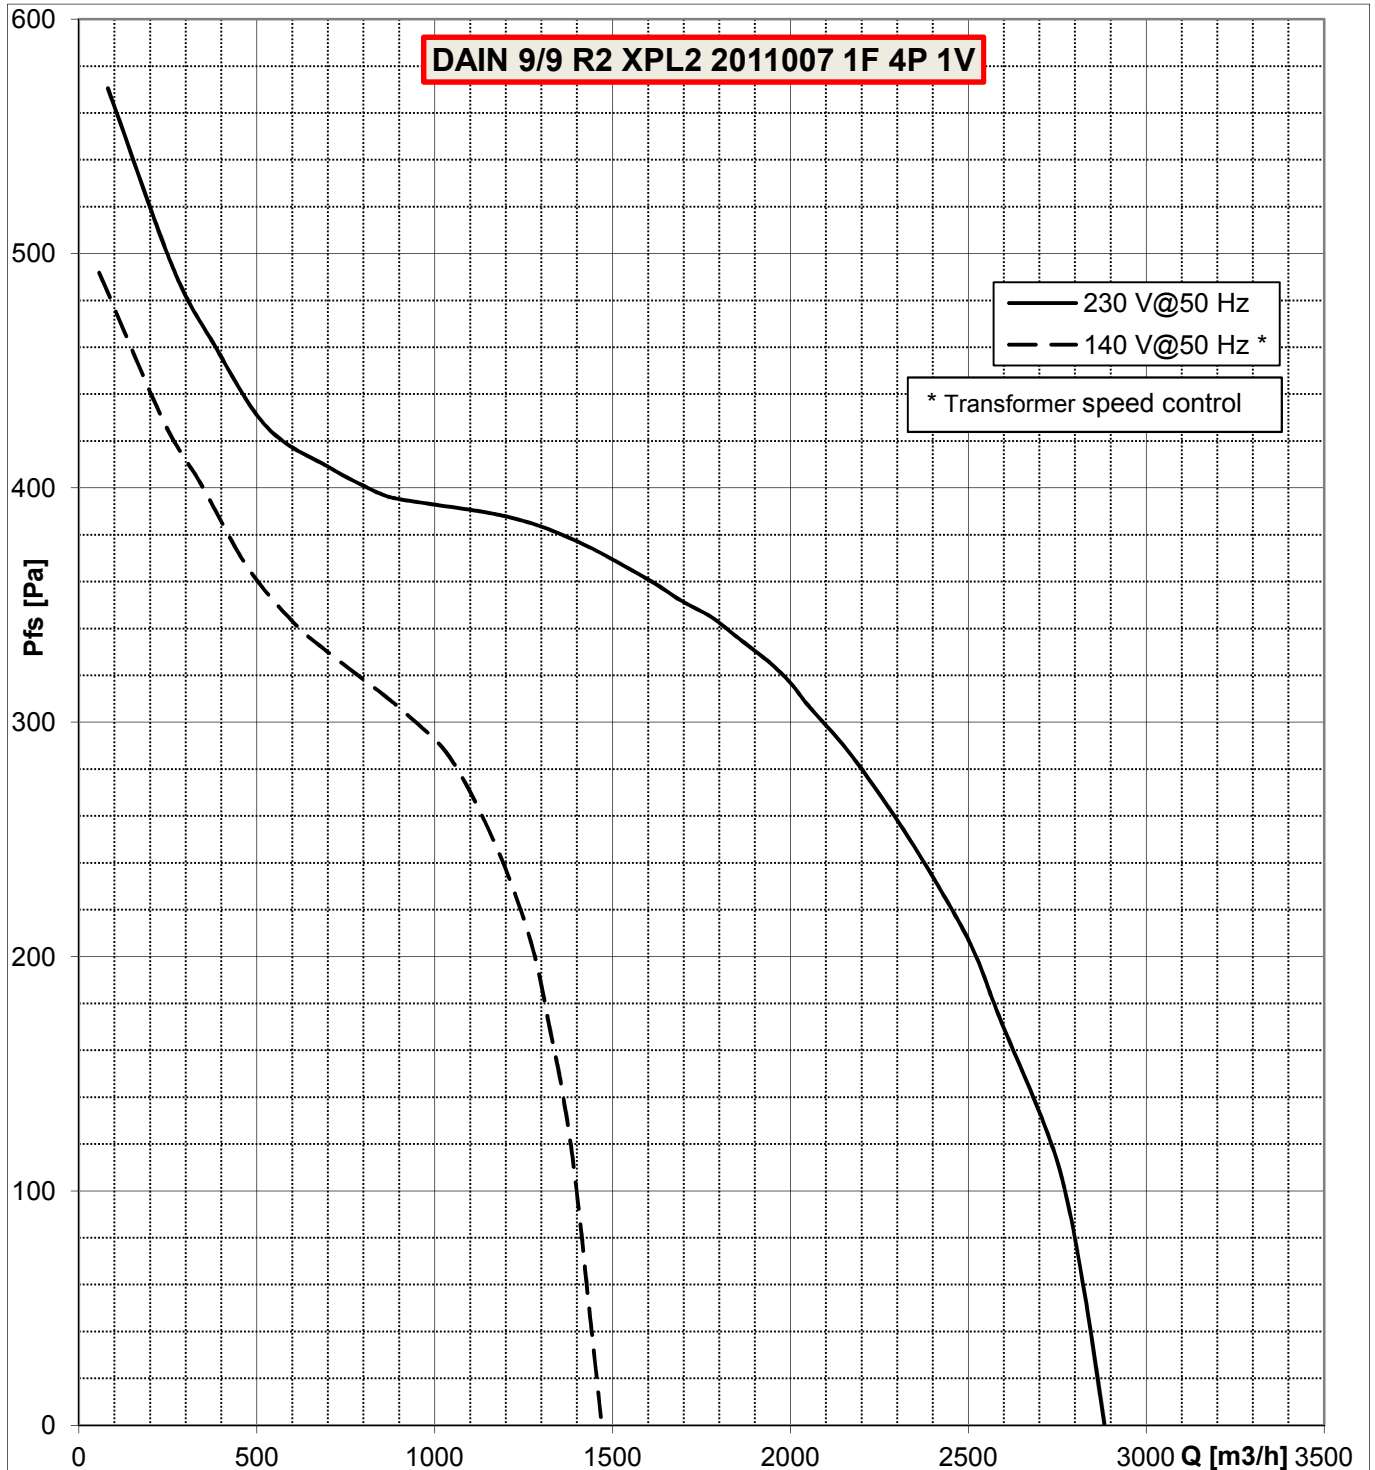

Data are not certified by AMCA