


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Unit type:	DAIN 6/7 XPL	Motor code:	SM00094	Motor Th.prot:	YES IN
Test nr.:	1720-1721	Motor power [W]:	105	Capacitor [μF]:	
Date:	2016/03/01	Motor poles:	4	Unit max. abs. current [A]:	1,3
Power supply[V]:	230 1~	Mot. prot. class:	IP40	Unit max. abs. power [W]:	280
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: ErP 2015

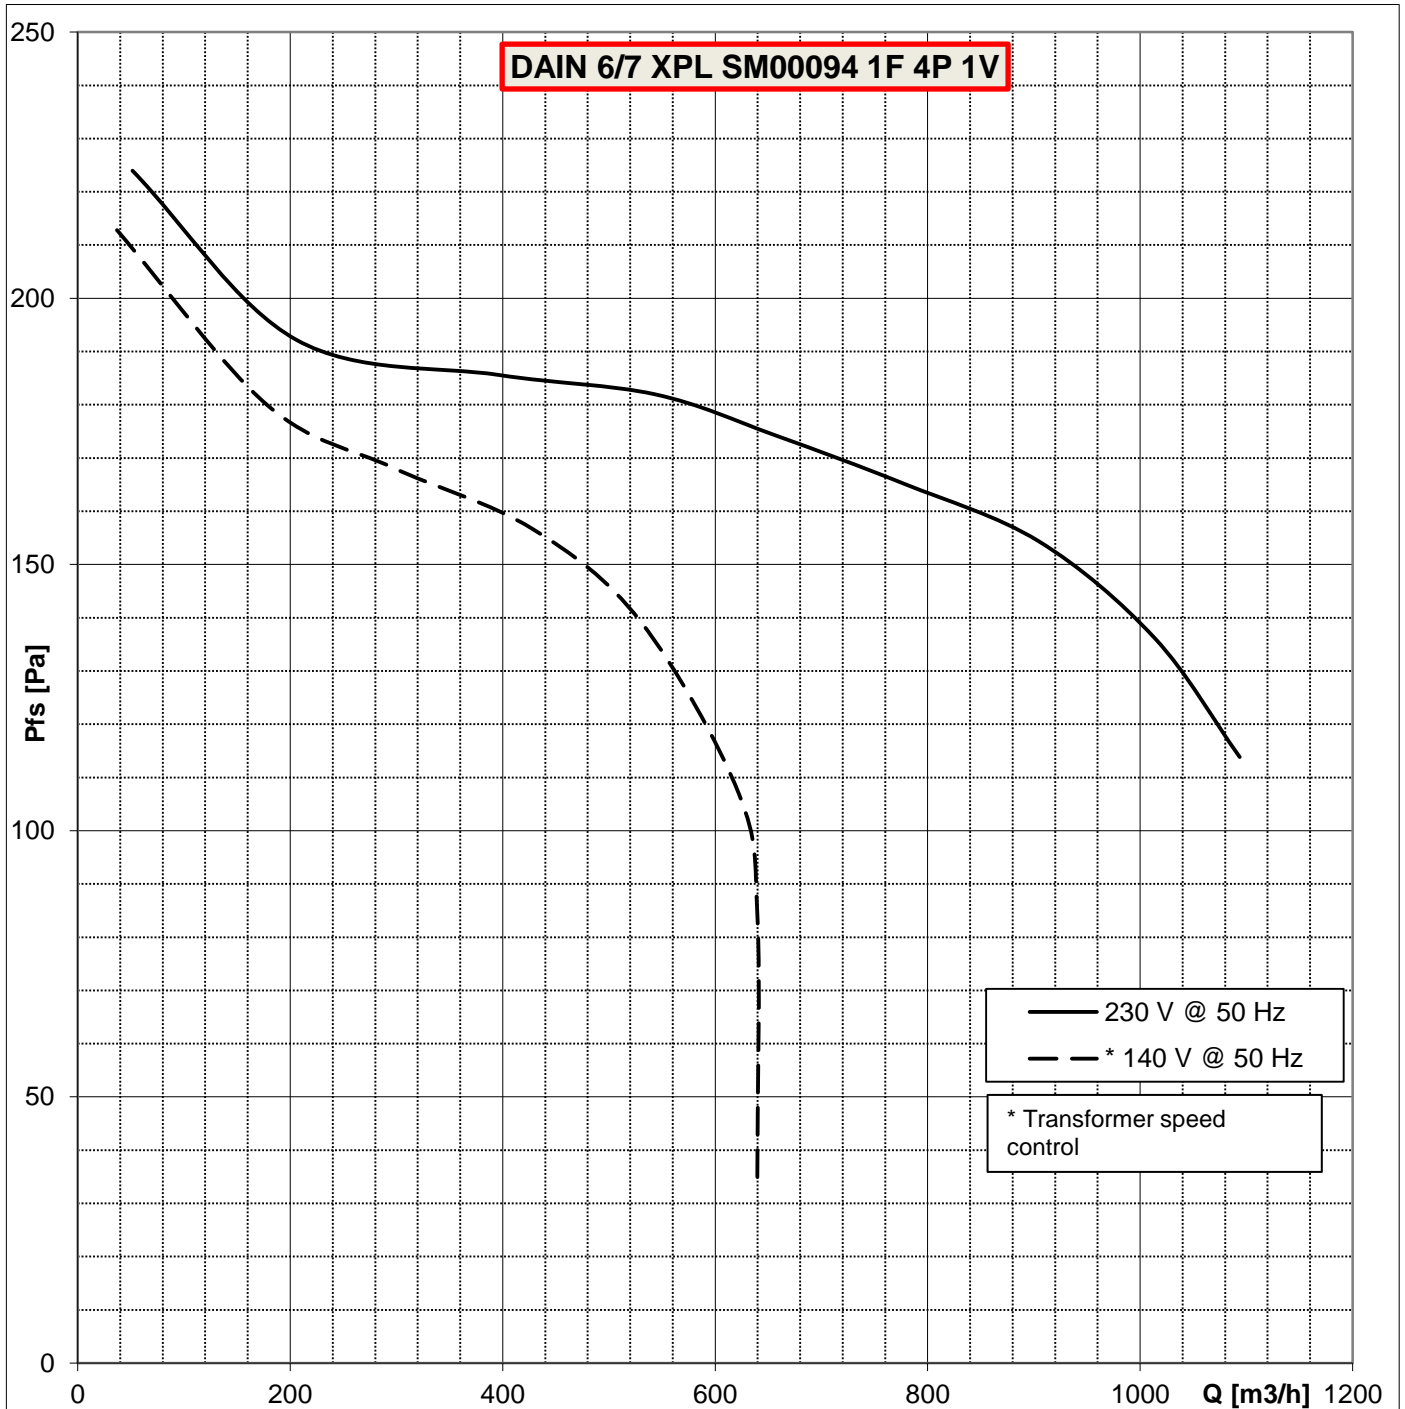

Data are not certified by AMCA