


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free field inlet side Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	DARE 9/9R XPL	Motor type:	2031004	T.H.:	YES IN
Test nr.:	796	Motor power [W]:	400	Capacitor [μF]:	10
Date:	2015/01/29	Motor poles:	4	Max. current [A]:	3,4
Power supply[V]:	230 1~	Prot. class:	IP44		
Frequency[Hz]:	50	Ins. class:	F		

Fan ErP status: ErP 2015

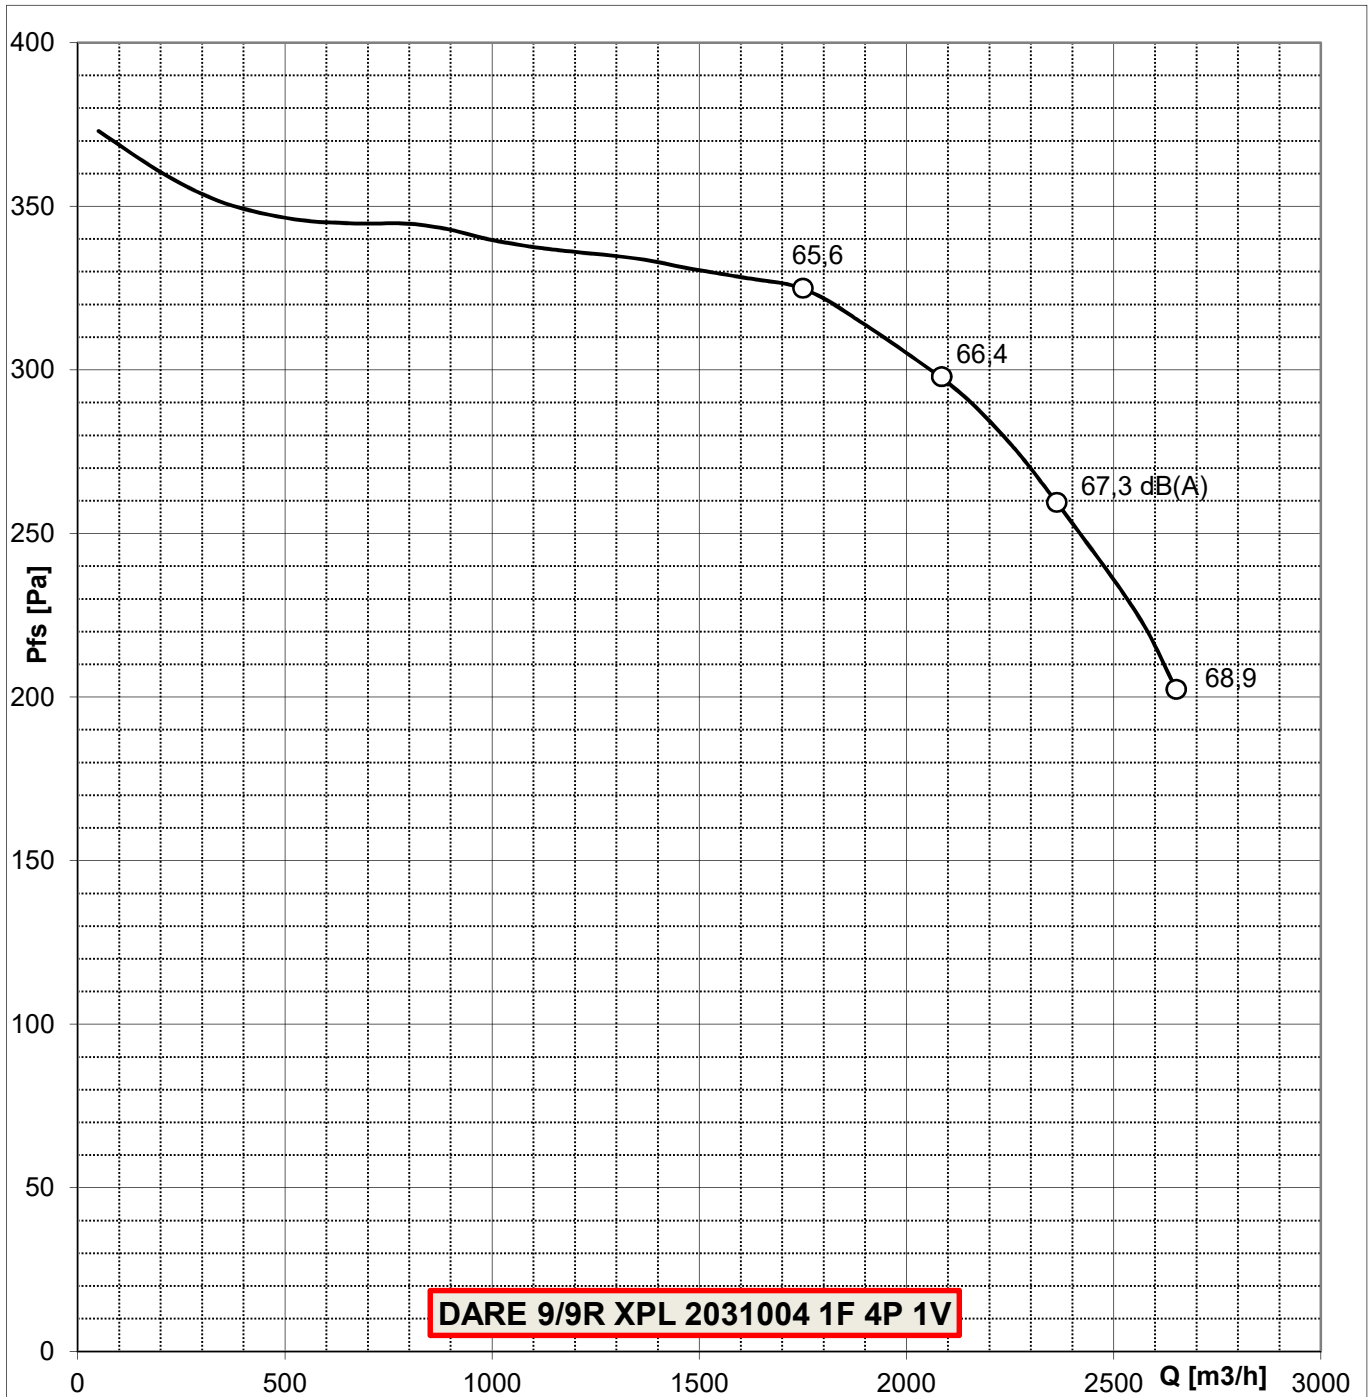

Data are not certified by AMCA.