


Fan type:	DARE 7/9 XPL	Motor code:	203100A	Motor T.H.:	YES OUT
Test nr.:	001-R	Motor power [W]:	400	Capacitor [μF]:	-
Date:	2015/10/09	Motor poles:	4	Fan max. abs. current [A]:	2.3/1.3
Power supply[V]:	230/400 3~	Mot. prot. class:	IP44		
Frequency [Hz]:	50/60	Mot. ins. class:	F		

Fan ErP status: ErP 2015



Data are not certified by AMCA

Fan type:	DARE 7/9 XPL	Motor code:	203100A	Motor T.H.:	YES OUT
Test nr.:	004-R	Motor power [W]:	400	Capacitor [μF]:	-
Date:	2015/10/09	Motor poles:	4	Fan max. abs. current [A]:	2.8/1.6
Power supply[V]:	230/400 3~	Mot. prot. class:	IP44		
Frequency [Hz]:	50/60	Mot. ins. class:	F		

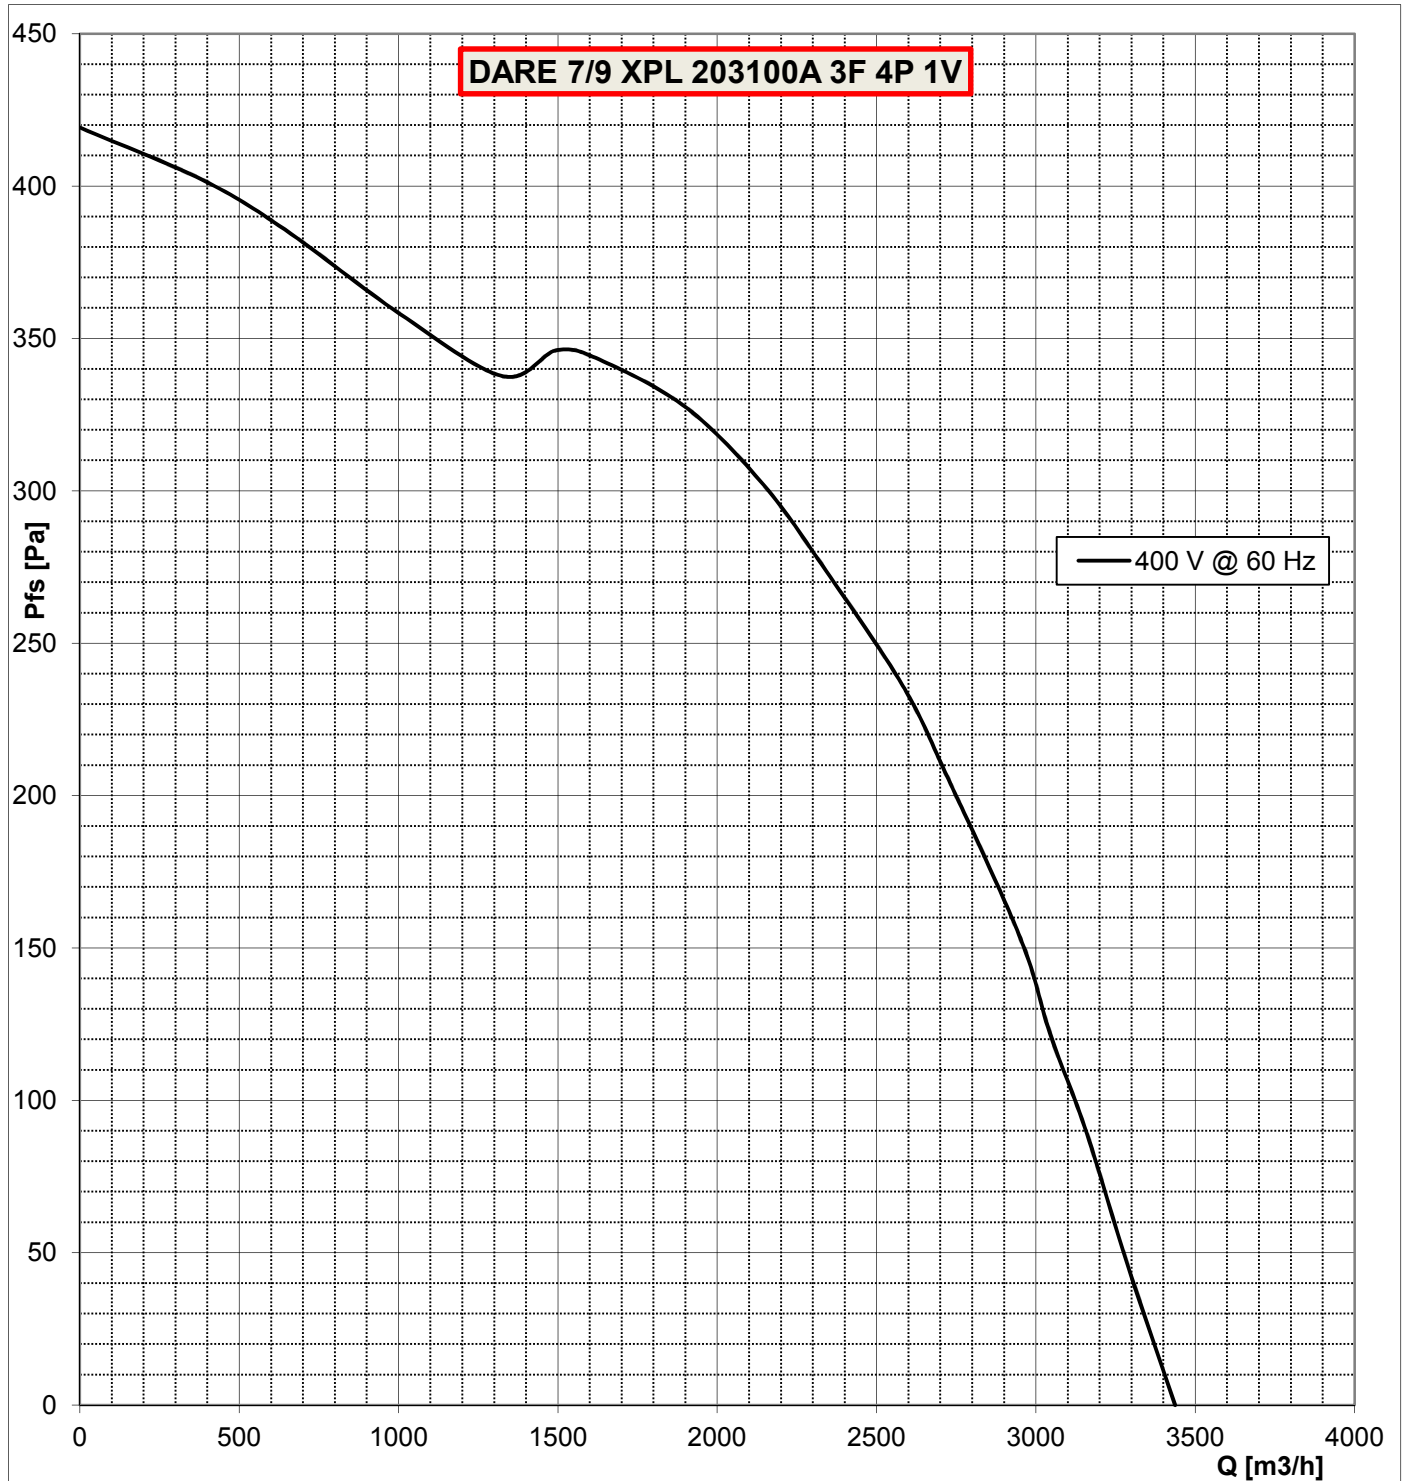


Data are not certified by AMCA

Air density (γ): 1.20 kg/m³

Installation type "B": free inlet, ducted outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Fan type:	DARE 7/9 XPL	Motor code:	203100A	Motor T.H.:	YES OUT
Test nr.:	002-R	Motor power [W]:	400	Capacitor [μF]:	-
Date:	2015/10/09	Motor poles:	4	Fan max. abs. current [A]:	2.8/1.6
Power supply[V]:	230/400 3~	Mot. prot. class:	IP44		
Frequency [Hz]:	50/60	Mot. ins. class:	F		

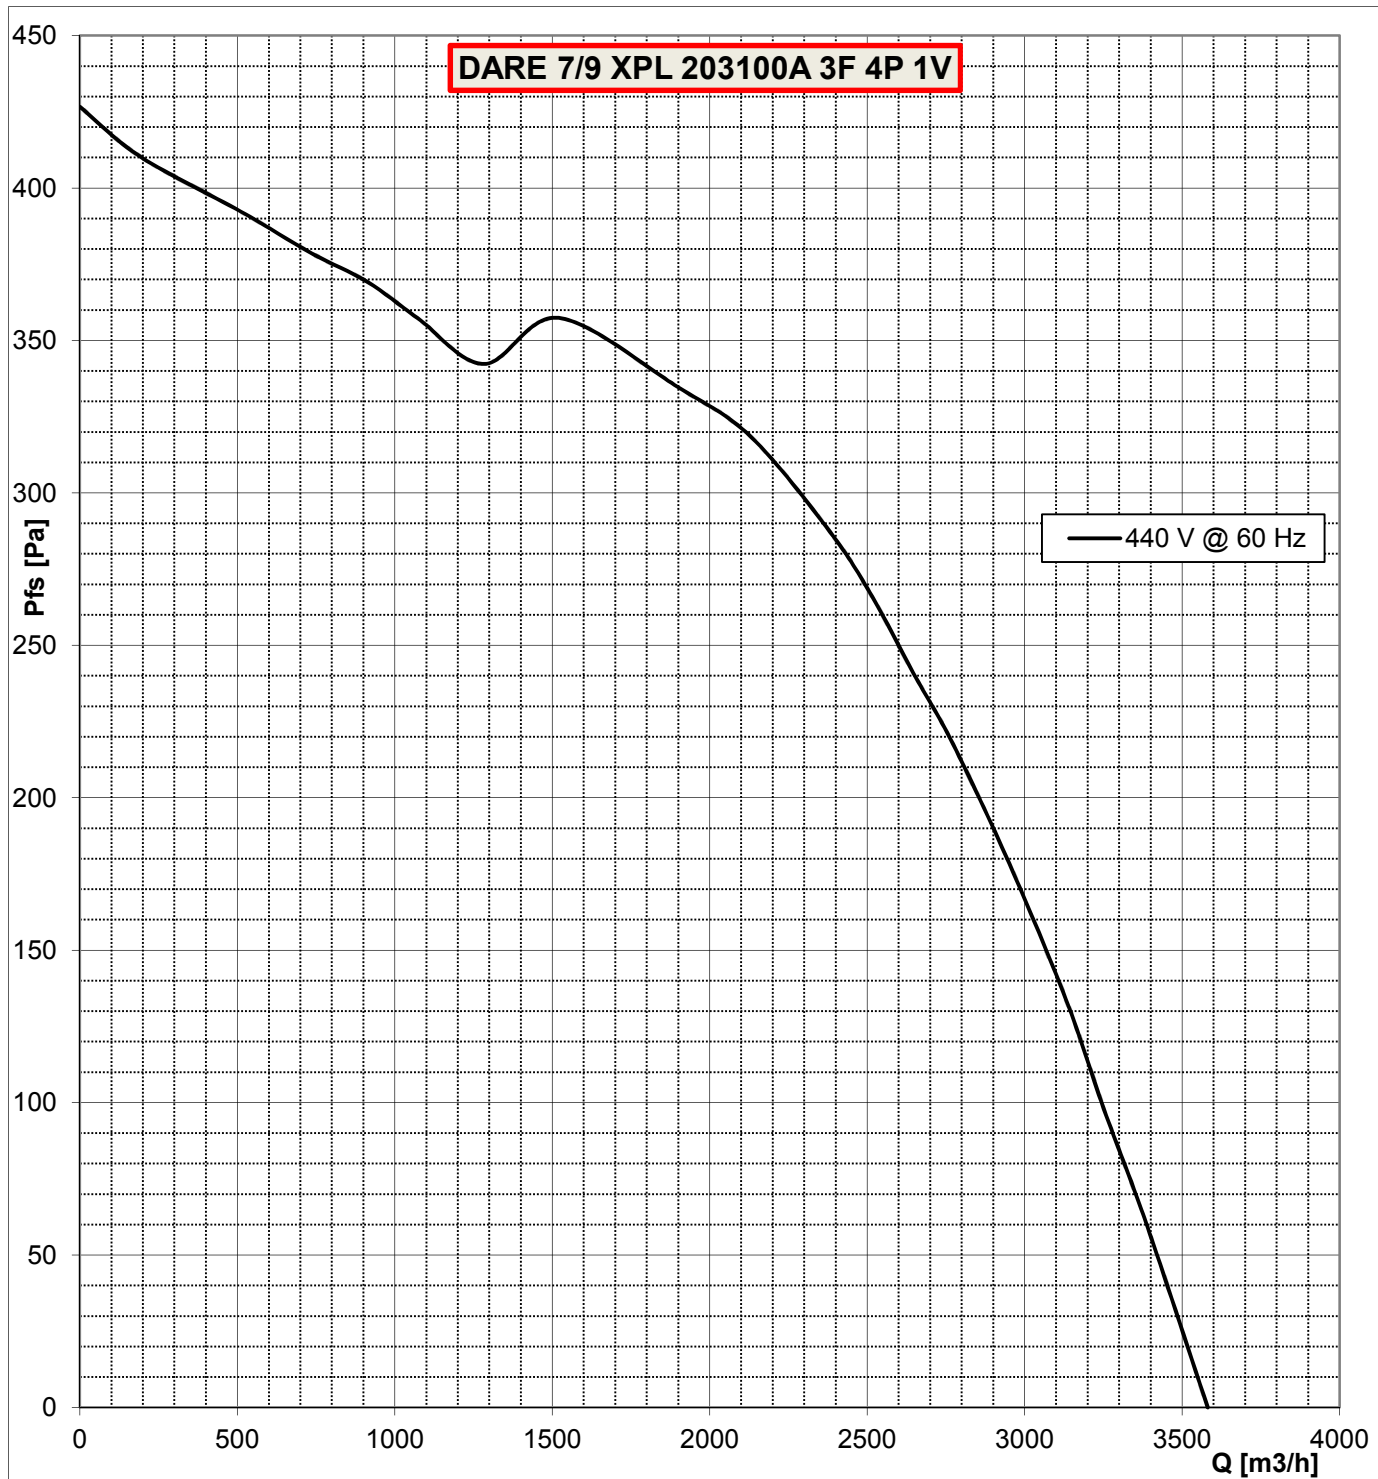

Data are not certified by AMCA