

Air density (γ): 1.20 kg/m³

Installation type "B": free inlet, ducted outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12


Inlet side free field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type: DARE 7/9 XPL
 Test nr.: 1763 - 1766
 Date: 2016/03/17
 Power supply[V]: 230 1~
 Frequency [Hz]: 50

Motor code: 2031008
 Motor power [W]: 300
 Motor poles: 4
 Mot. prot. class: IP44
 Mot. ins. class: F

Motor T.H.: YES IN
 Capacitor [μ F]: 10
 Fan max. abs. current [A]: 2.8

Fan ErP status: ErP 2015

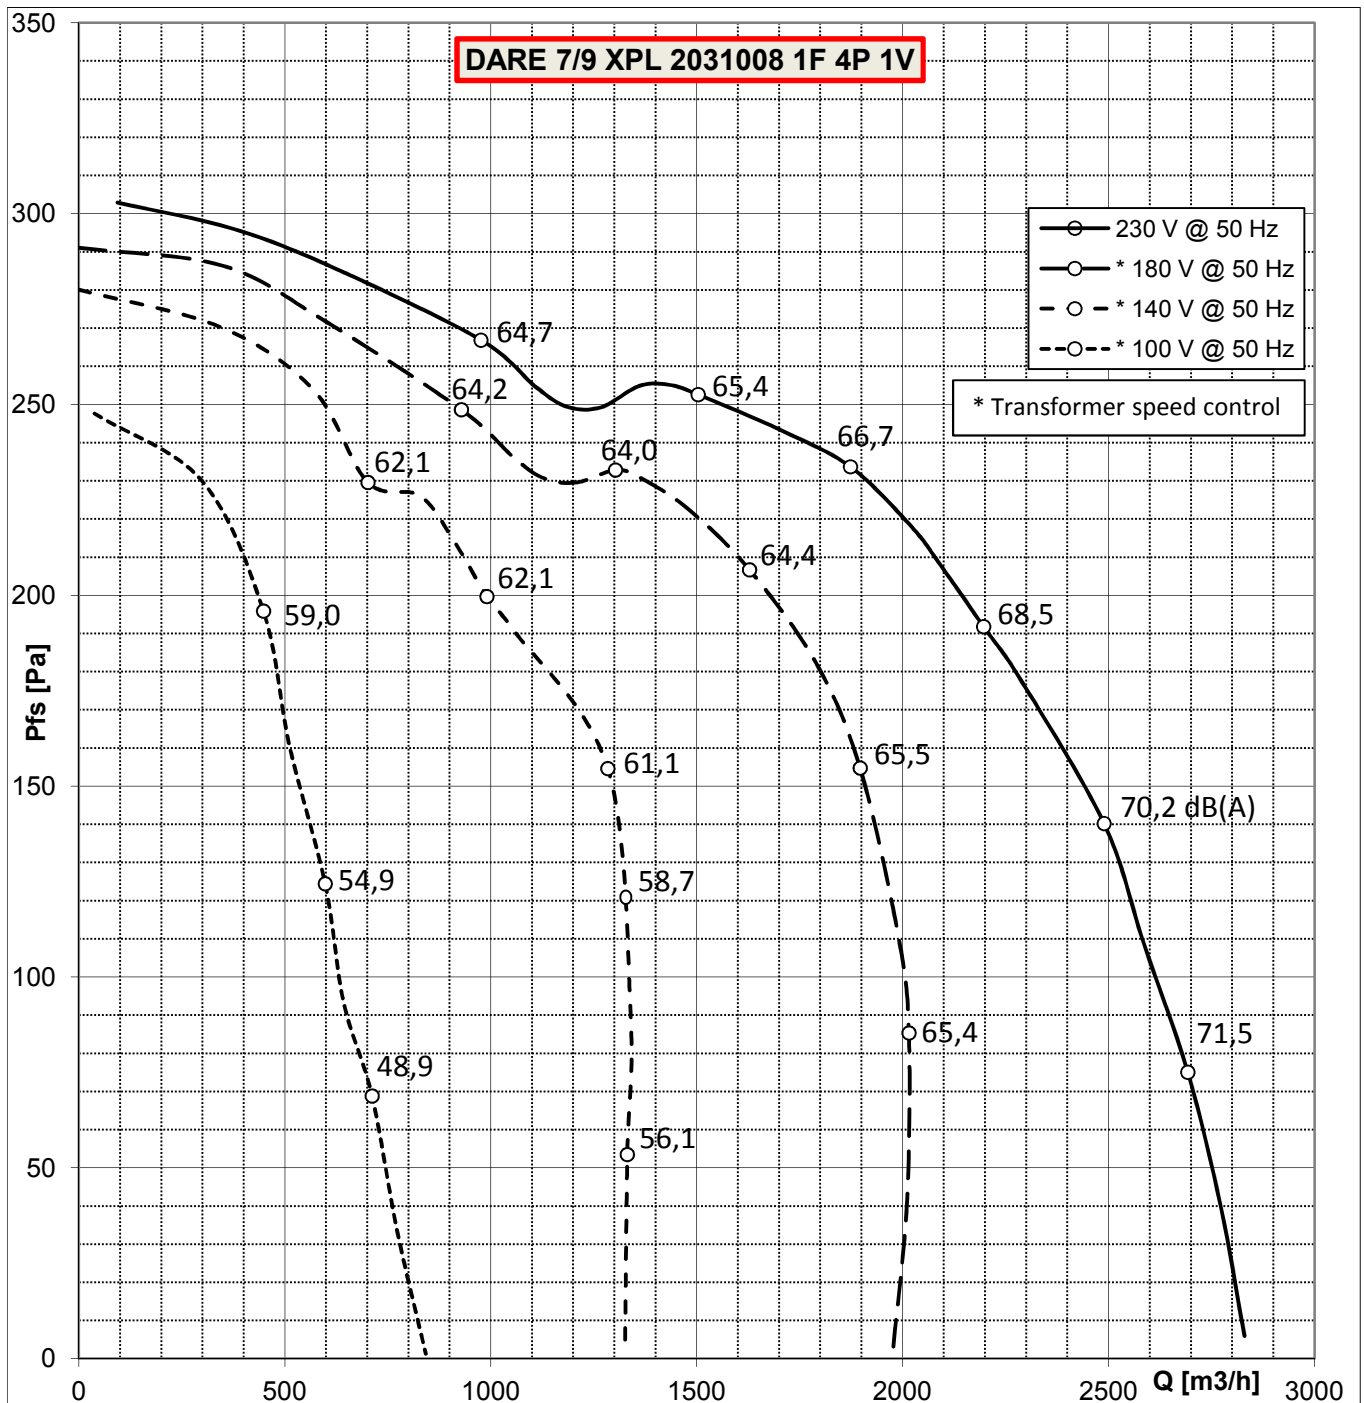

Data are not certified by AMCA