


Air density (γ): 1.20 kg/m³

Installation type "B": free inlet, ducted outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Free-field inlet side Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	DARE 7/9	Motor code:	203100D	Motor T.H.:	YES IN
Test nr.:	1895, 1899, 1900	Motor power [W]:	400	Capacitor [μF]:	40
Date:	2015/06/24	Motor poles:	4	Fan max. abs. current [A]:	6,7
Power supply[V]:	120 1~	Mot. prot. class:	IP44		
Frequency [Hz]:	60	Mot. ins. class:	F		

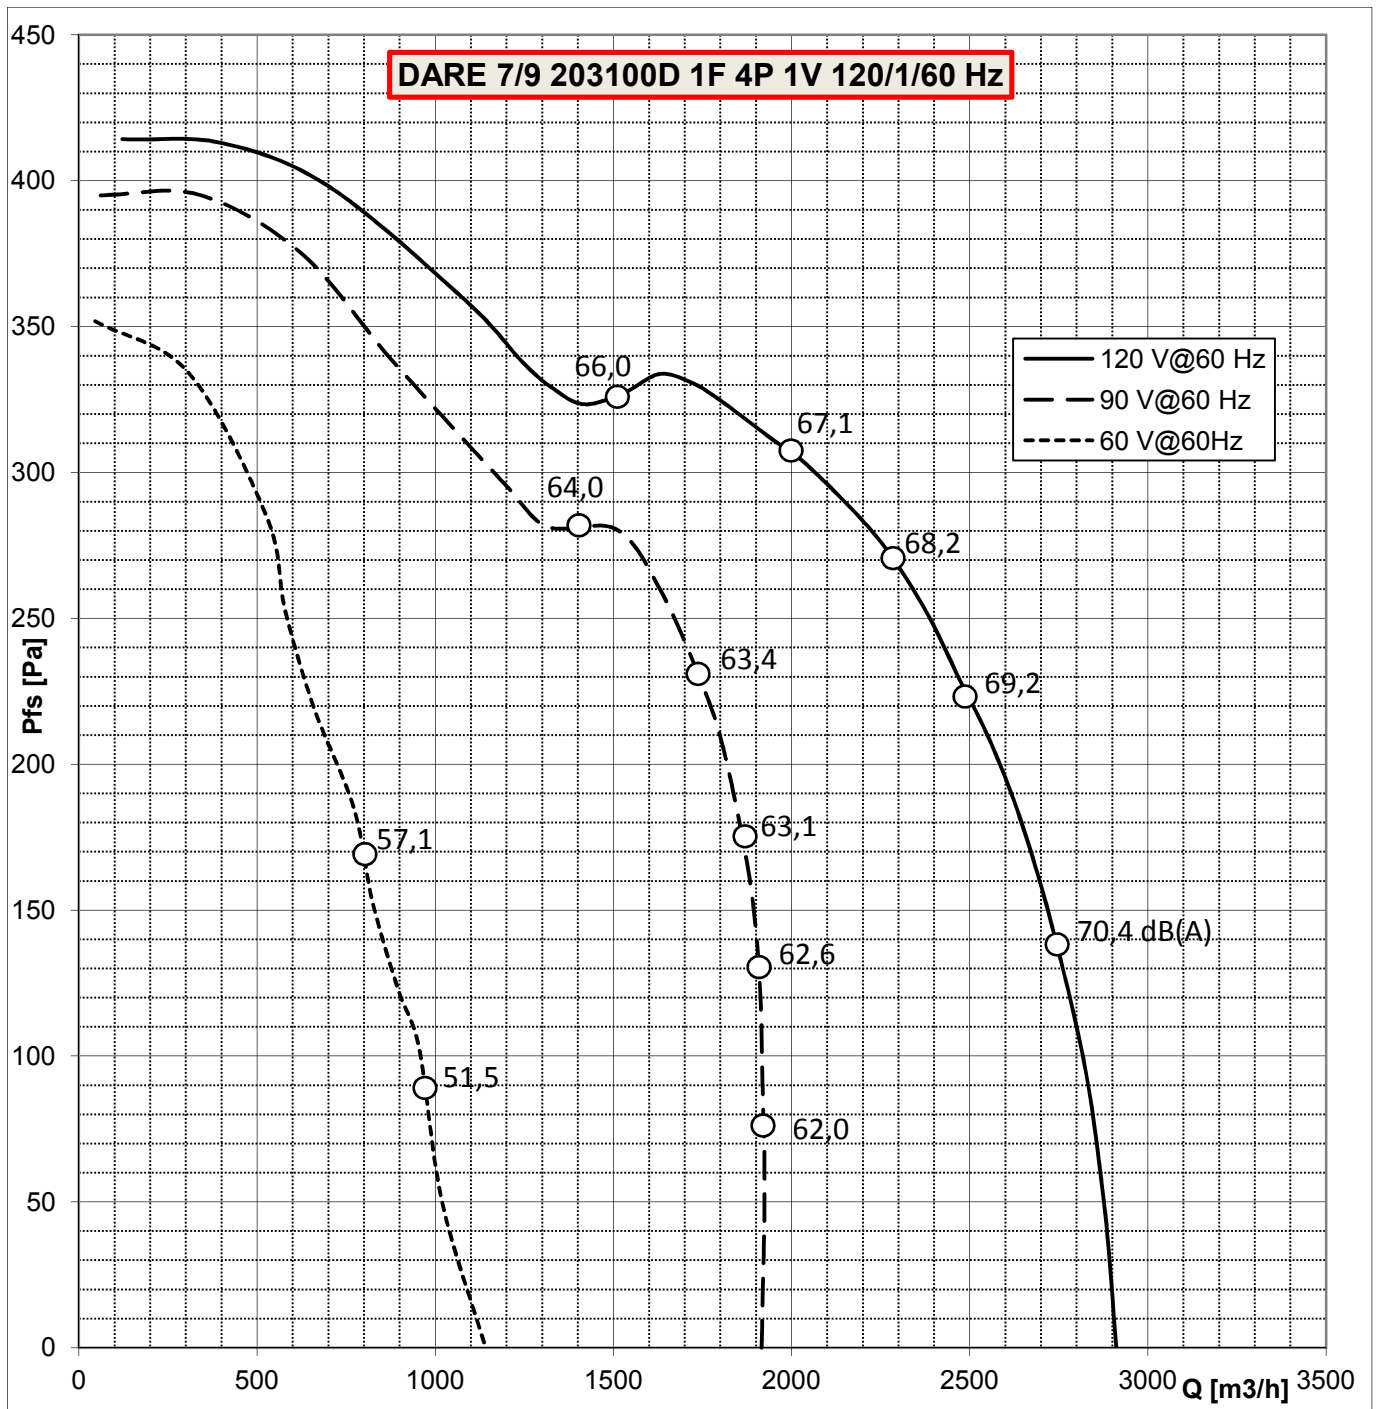

Data are not certified by AMCA


Air density (γ): 1.20 kg/m³

Installation type "B": free inlet, ducted outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Free-field inlet side Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	DARE 7/9	Motor code:	203100D	Motor T.H.:	YES IN
Test nr.:	1898	Motor power [W]:	400	Capacitor [μF]:	40
Date:	2015/06/24	Motor poles:	4	Fan max. abs. current [A]:	5,1
Power supply[V]:	120 1~	Mot. prot. class:	IP44		
Frequency [Hz]:	50	Mot. ins. class:	F		

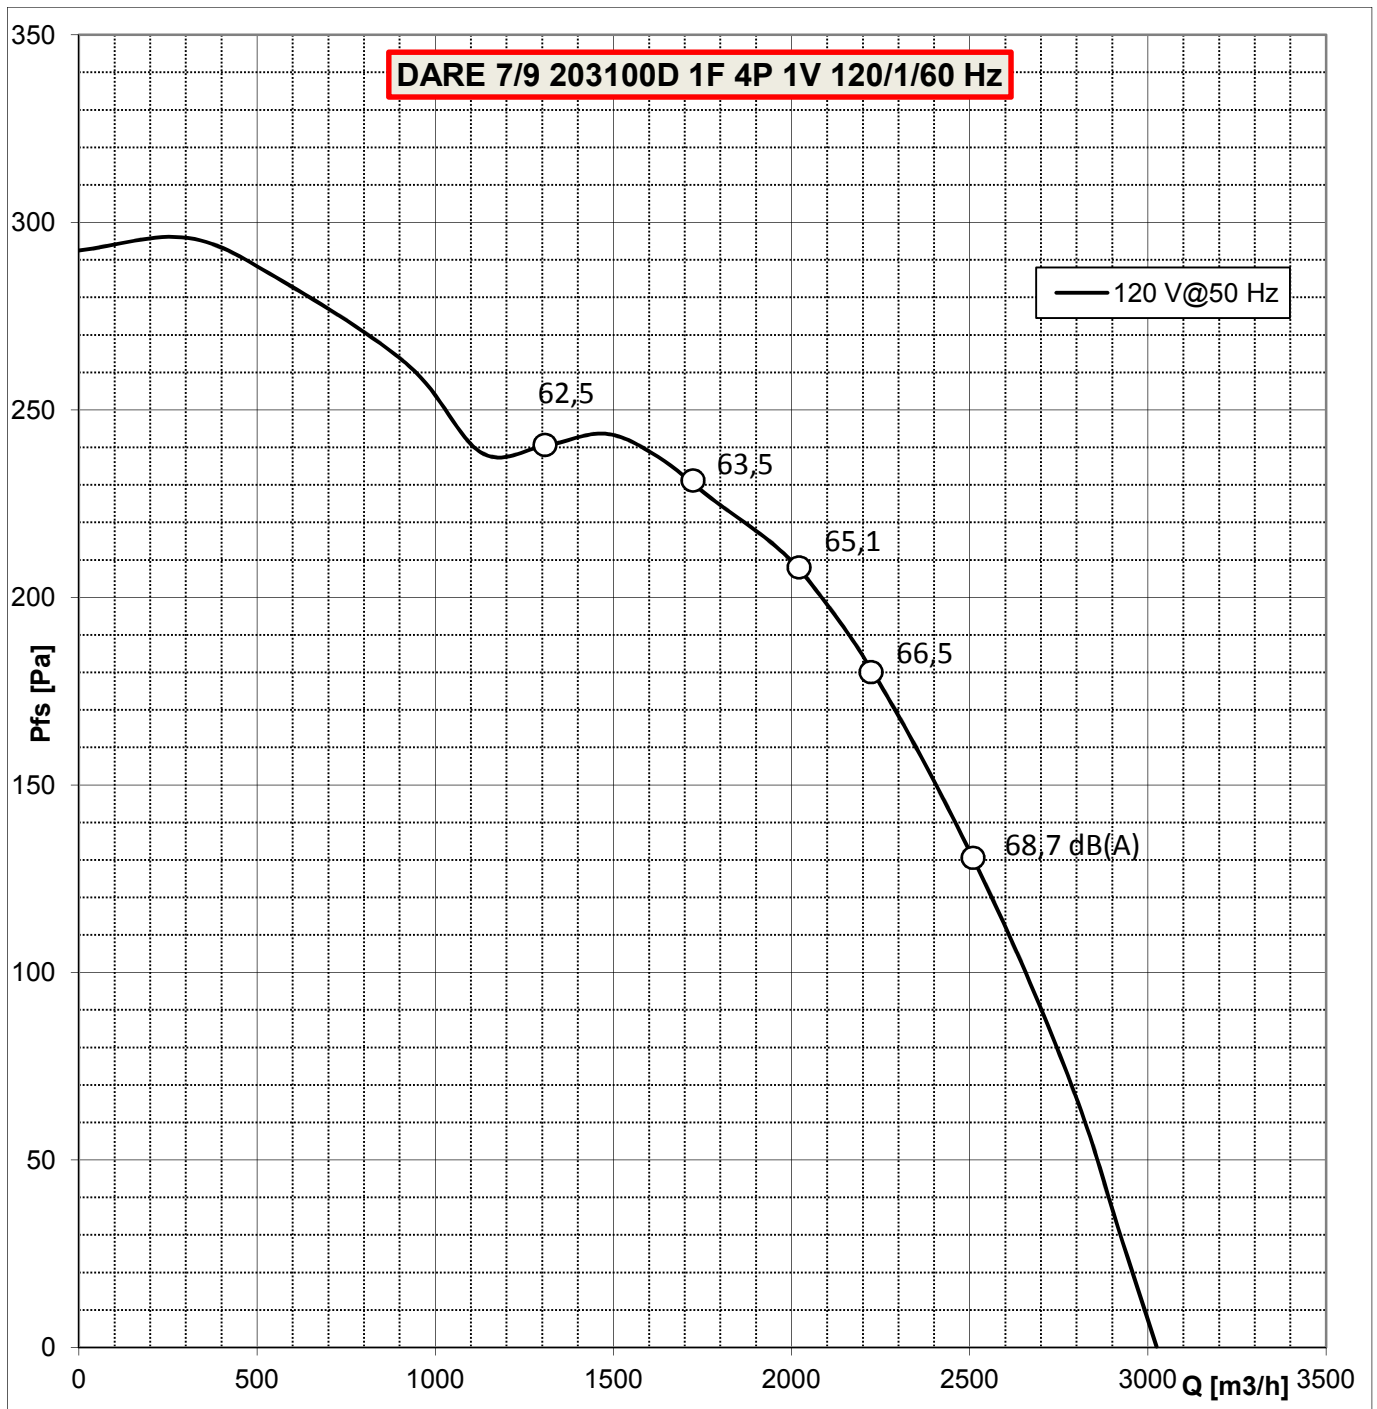

Data are not certified by AMCA