


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free-field inlet side Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	DARE 7/7 XPL	Motor code:	211100G	Motor T.H.:	YES-IN
Test nr.:	2228, 2229, 2895, 2896	Motor power [W]:	120	Capacitor [μF]:	6
Date:	2017/02/15	Motor poles:	4	Fan max. abs. current [A]:	1,3
Power supply[V]:	230 1~	Mot. prot. class:	IP44		
Frequency [Hz]:	50	Mot. ins. class:	F		

Fan ErP status: ErP 2015

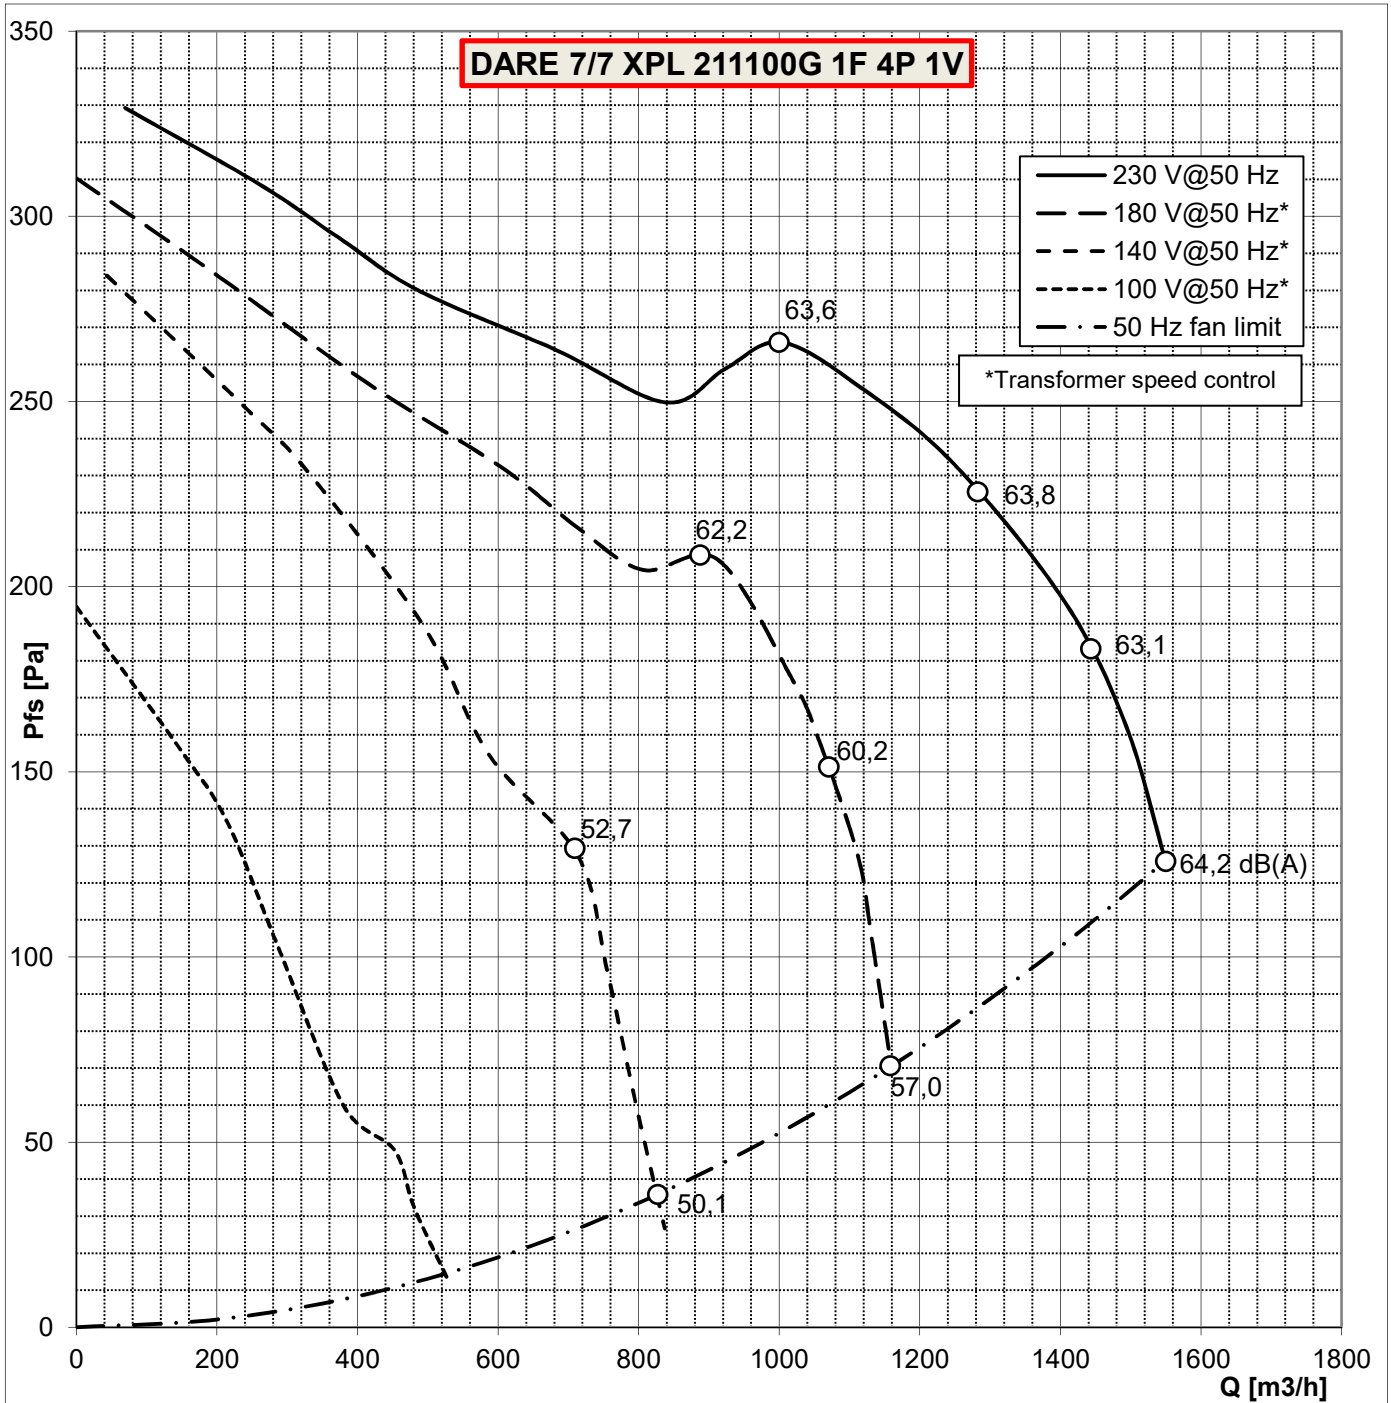

Data are not certified by AMCA