


Air density (γ): 1.20 kg/m³
Installation type "A": free inlet, free outlet
12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Fan type:	DARE 7/12 XPL2	Motor code:	SM00054	Motor T.H.:	YES OUT
Test nr.:	1556	Motor power [W]:	200	Capacitor [μ F]:	-
Date:	2015/10/05	Motor poles:	4	Fan max. abs. current [A]:	1.73/1
Power supply[V]:	230/400 3~	Mot. prot. class:	IP54		
Frequency [Hz]:	50	Mot. ins. class:	F		

Fan ErP status: ErP 2015

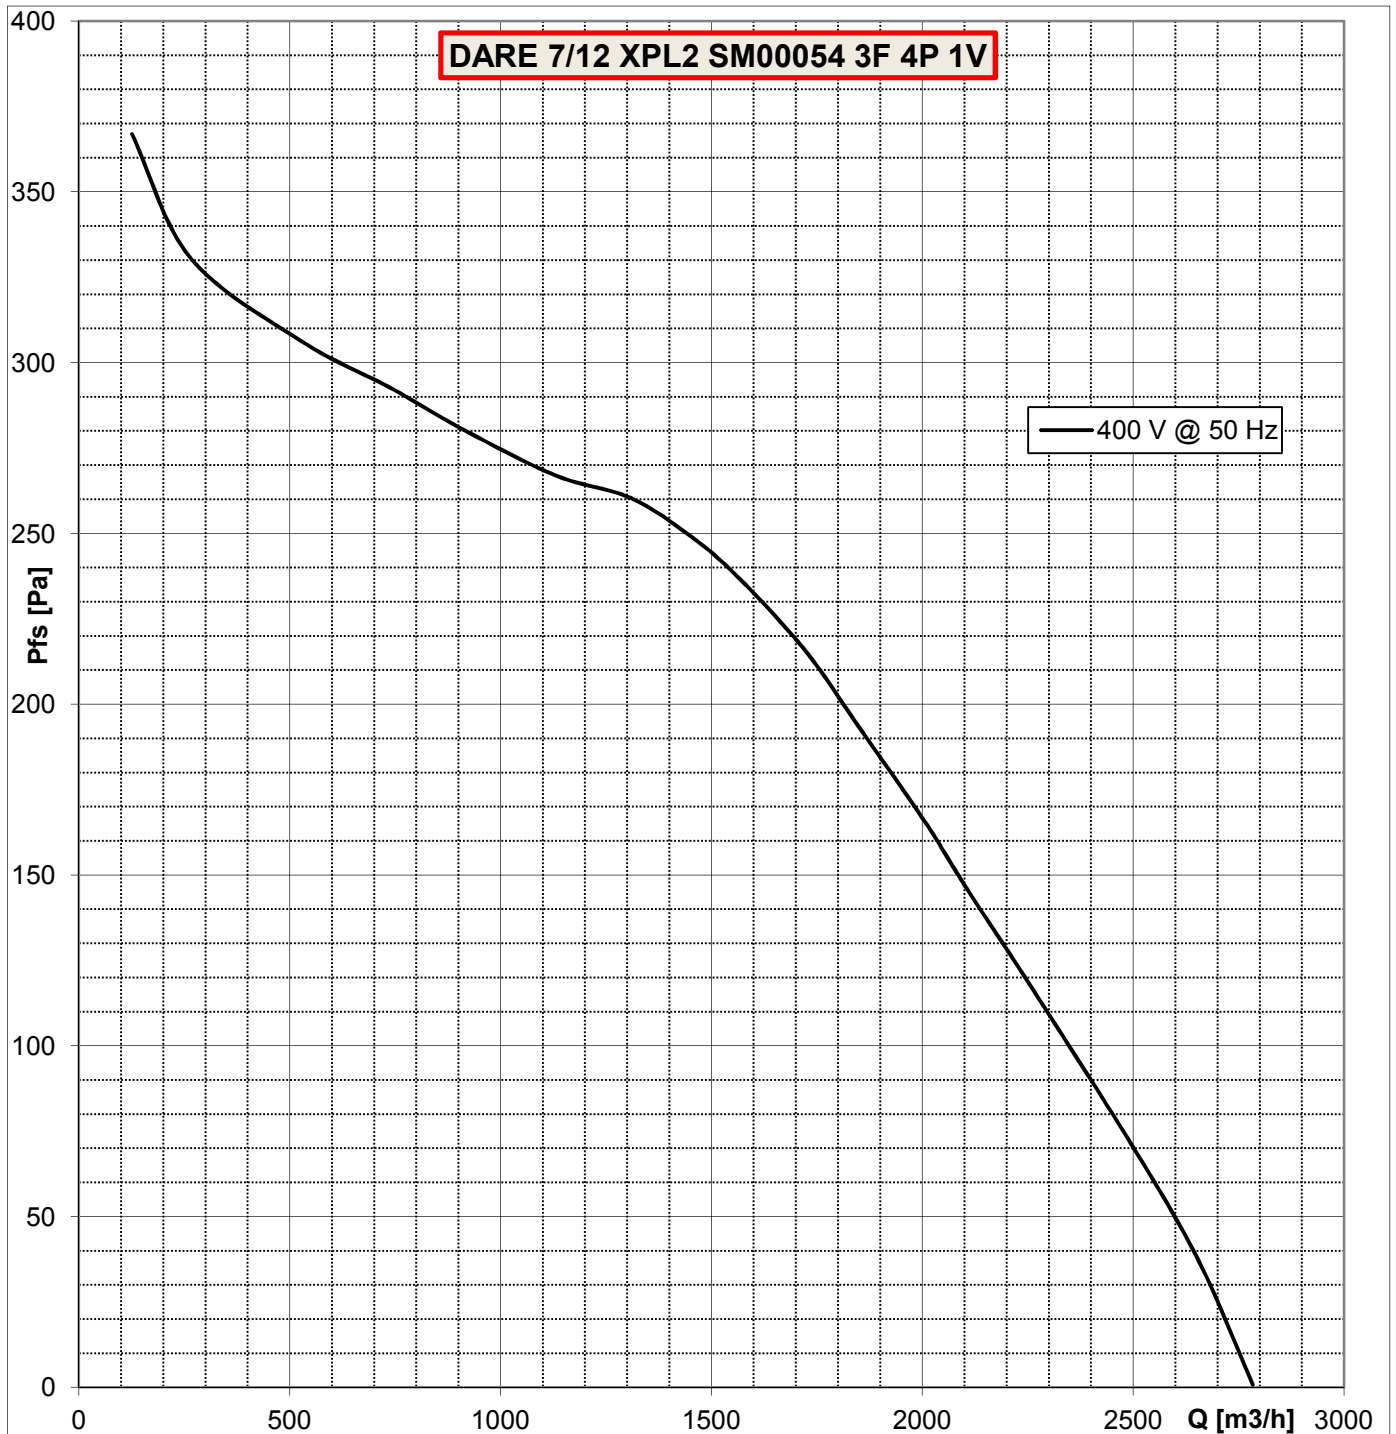

Data are not certified by AMCA