

Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>


Installation type "A": free inlet, free outlet

12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12

Inlet side free field Lp(A) measurements at 1 m according to ISO 3746:2011

<b>Fan type:</b>	DARE 133/190 XPL	<b>Motor code:</b>	SM00093	<b>Motor T.H.:</b>	YES IN
<b>Test nr.:</b>	1172-1175	<b>Motor power [W]:</b>	40	<b>Capacitor [<math>\mu</math>F]:</b>	3
<b>Date:</b>	2015/03/23	<b>Motor poles:</b>	4	<b>Fan max. abs. current [A]:</b>	0.57
<b>Power supply[V]:</b>	230 1~	<b>Mot. prot. class:</b>	IP55		
<b>Frequency [Hz]:</b>	50	<b>Mot. ins. class:</b>	F		

Fan ErP status: not subjected to ErP Regulation (Pe<125 W)

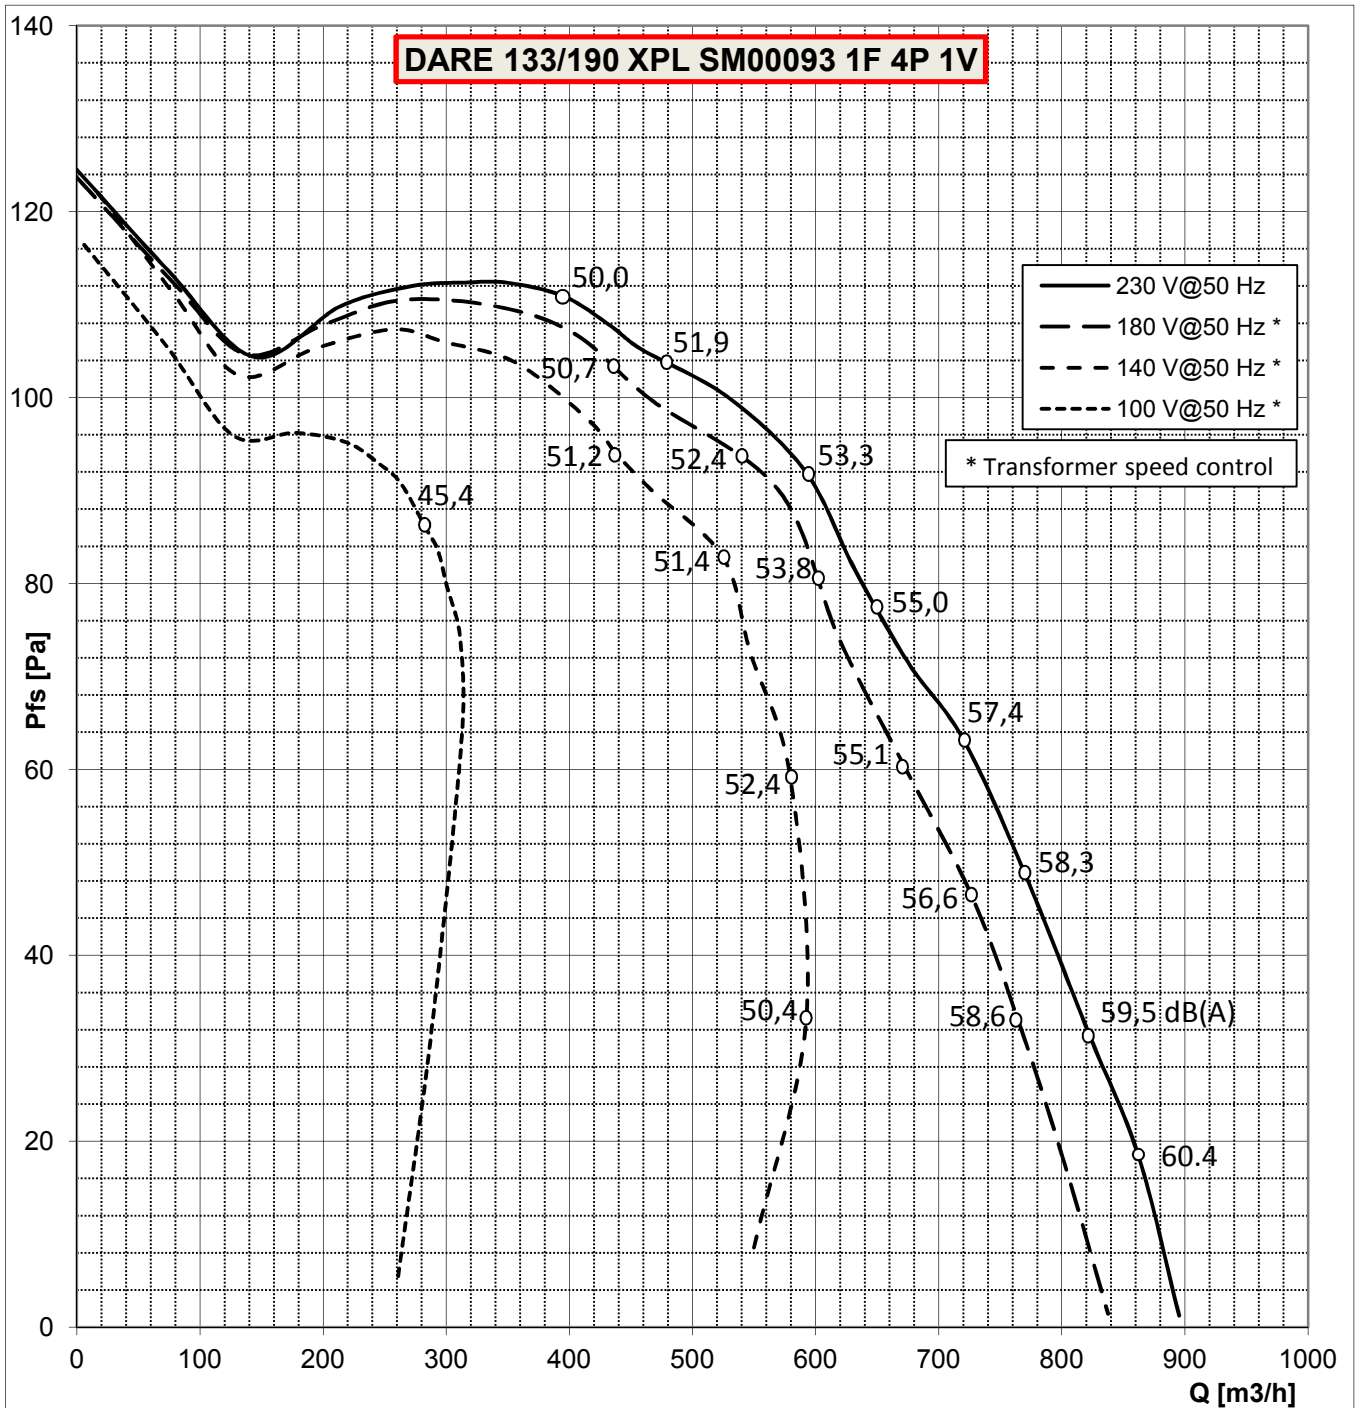

Data are not certified by AMCA