


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, free outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Fan type:	DARE 120/126 XPL	Motor code:	SM00156	Motor T.H.:	YES IN
Test nr.:	3004 - 3005	Motor power [W]:	75 (in)	Capacitor [μF]:	2
Date:	2018/09/07	Motor poles:	2	Fan max. abs. current [A]:	0,5
Power supply[V]:	230 1~	Mot. prot. class:	IP44		
Frequency [Hz]:	50	Mot. ins. class:	F		

Fan ErP status: Not subjected to ErP Regulation (Pe < 125 W)

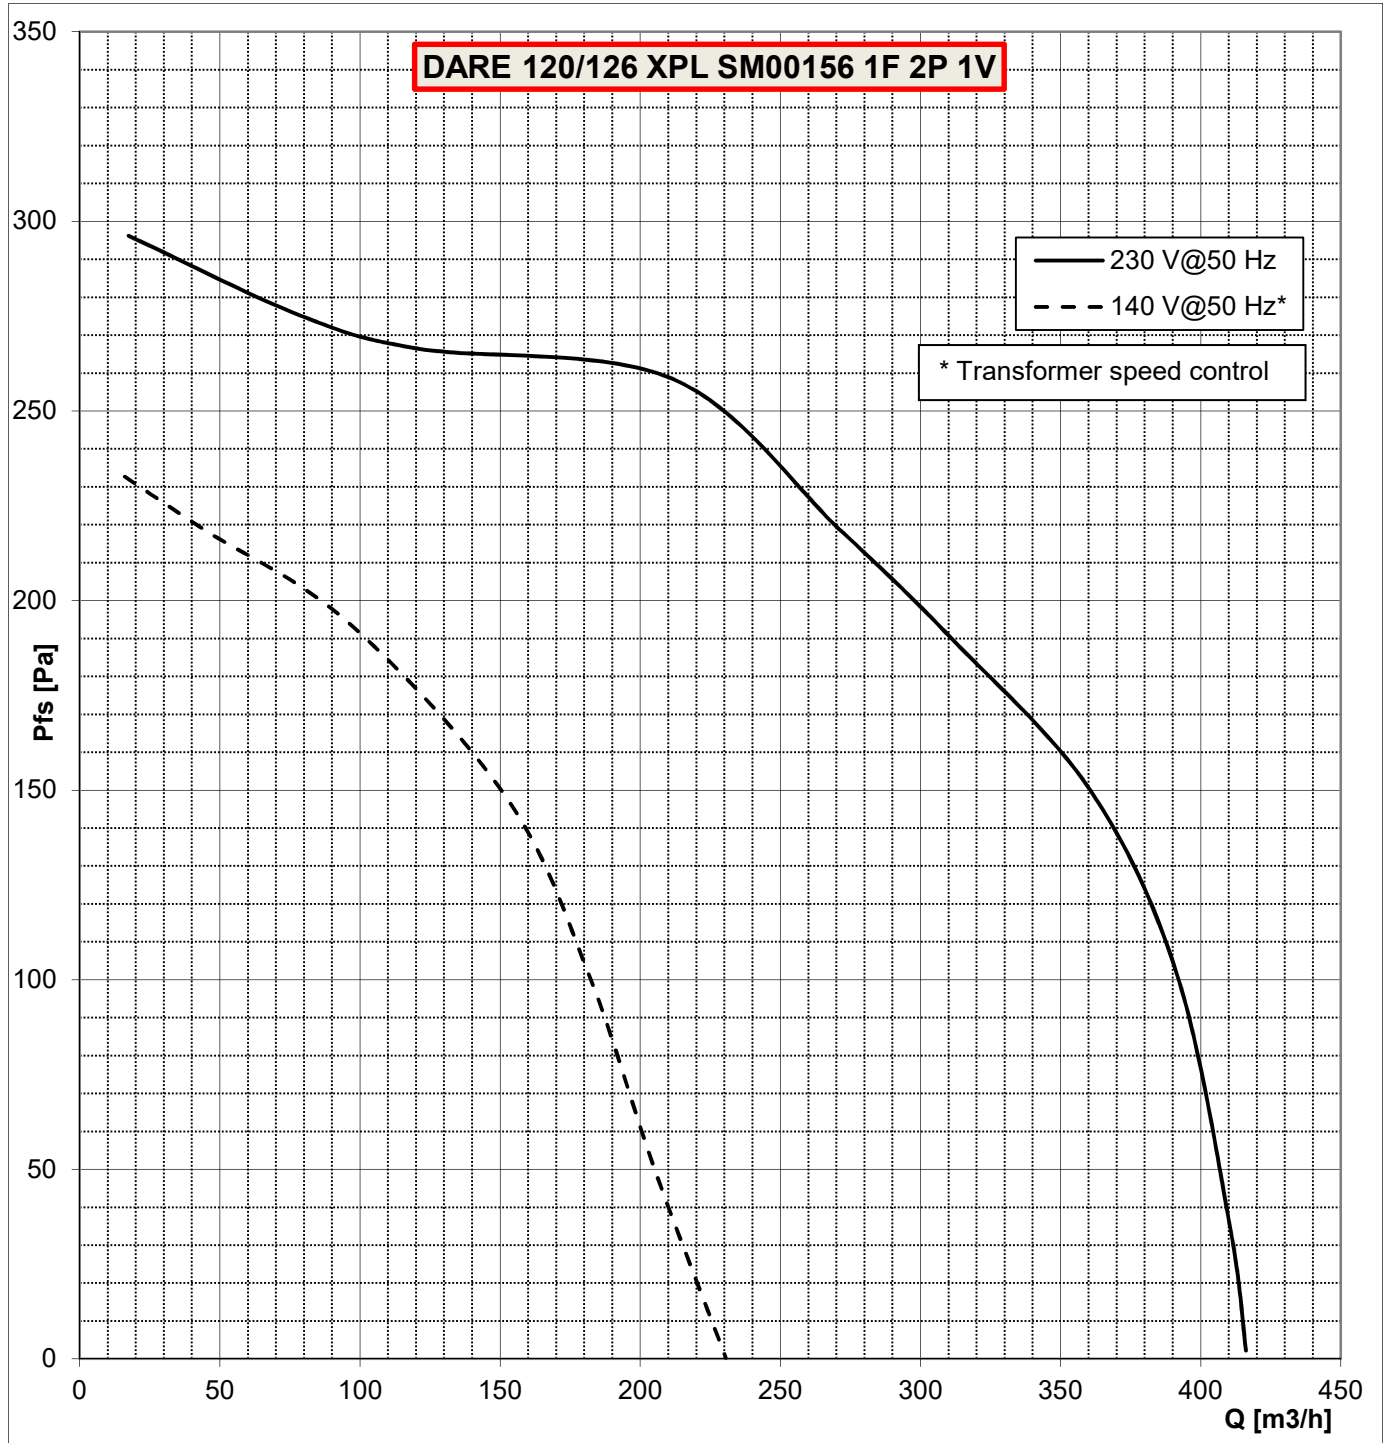

Data are not certified by AMCA