


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Fan type: DAREB 10/8 XPL3
 Test nr.: 1551, 1552, 1553
 Date: 2015/10/19
 Power supply[V]: 400 3~
 Frequency [Hz]: 50/60

Motor code: 2032000
 Motor power [W]: 1700(in)
 Motor poles: -
 Mot. prot. class: IP54
 Mot. ins. class: F

Motor T.H.: SW alarm
 Capacitor [μ F]: -
 Fan max. abs. current [A]: 2,7

Fan ErP status: ErP 2015

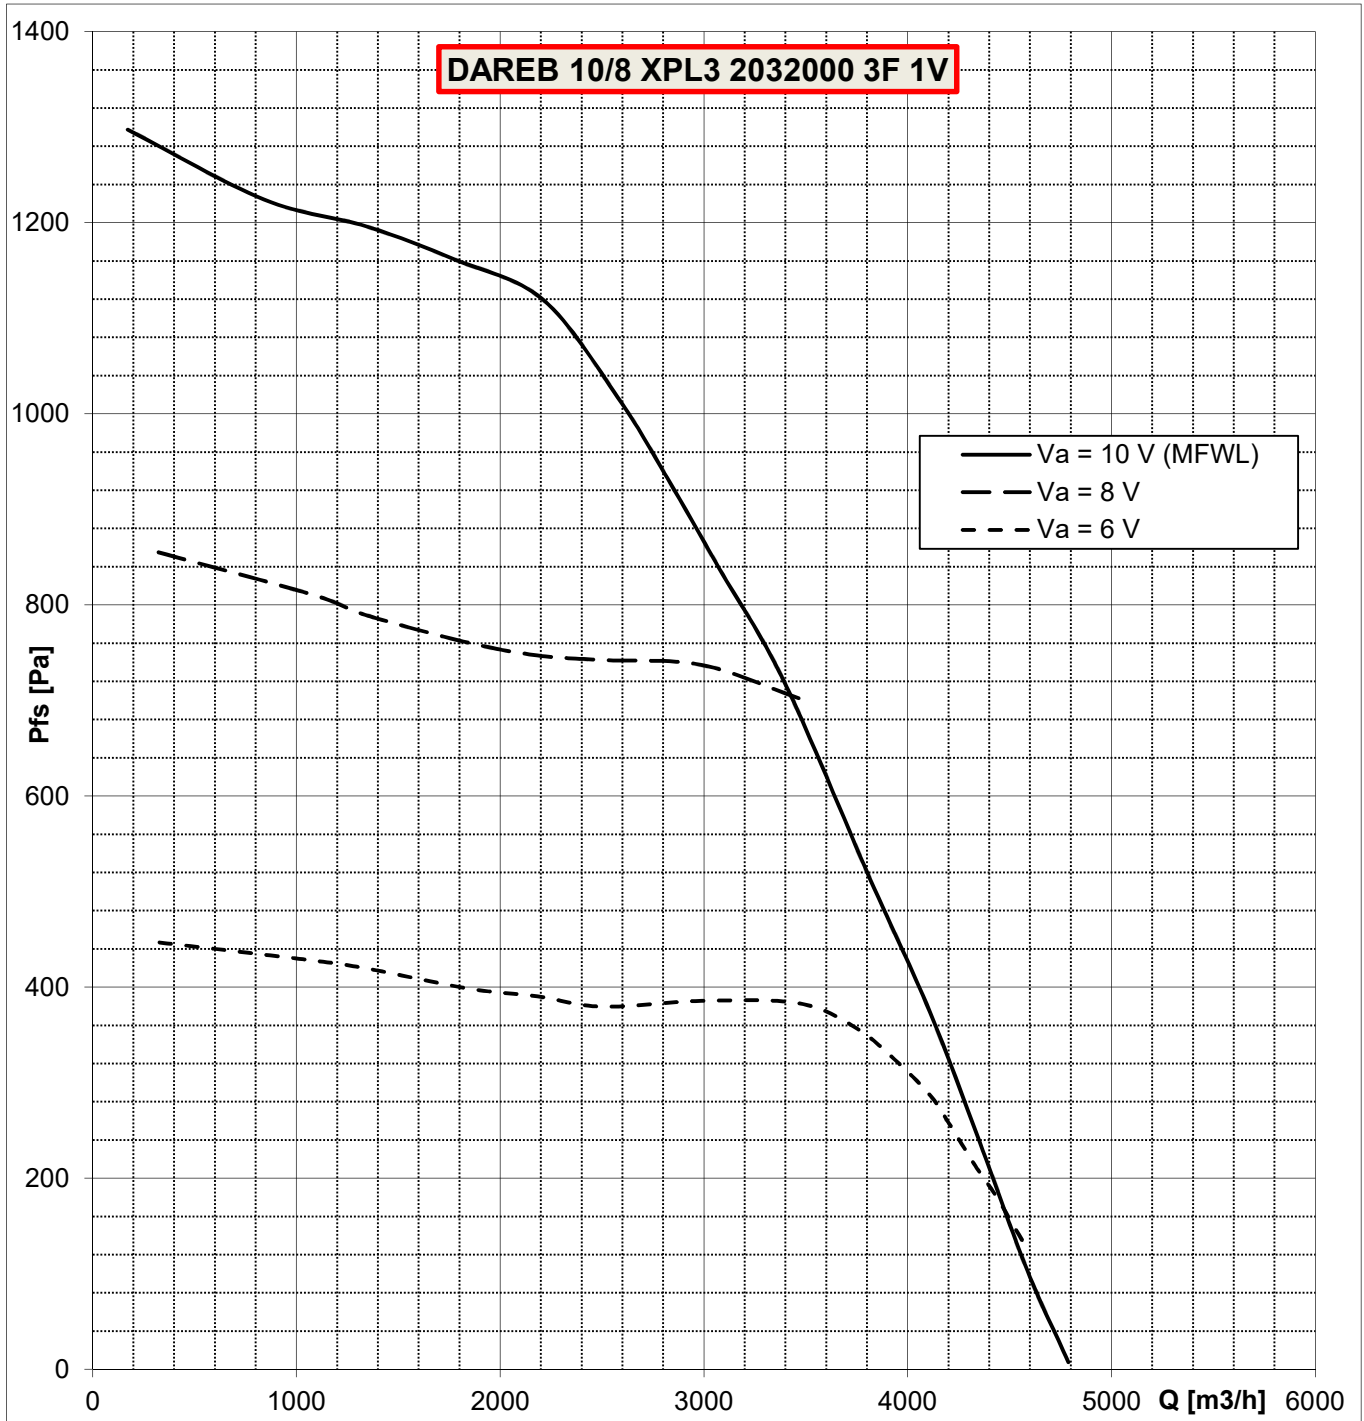

Data are not certified by AMCA