


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Fan type:	DAREB 9/7 XPL5	Motor code:	SM00048	Motor T.H.:	SW alarm
Test nr.:	1390, 1393, 1394	Motor power [W]:	480	Capacitor [μF]:	-
Date:	2015/07/17	Motor poles:	-	Fan max. abs. current [A]:	3.5
Power supply[V]:	230 1~	Mot. prot. class:	IP54		
Frequency [Hz]:	50	Mot. ins. class:	F		

Fan ErP status: ErP 2015

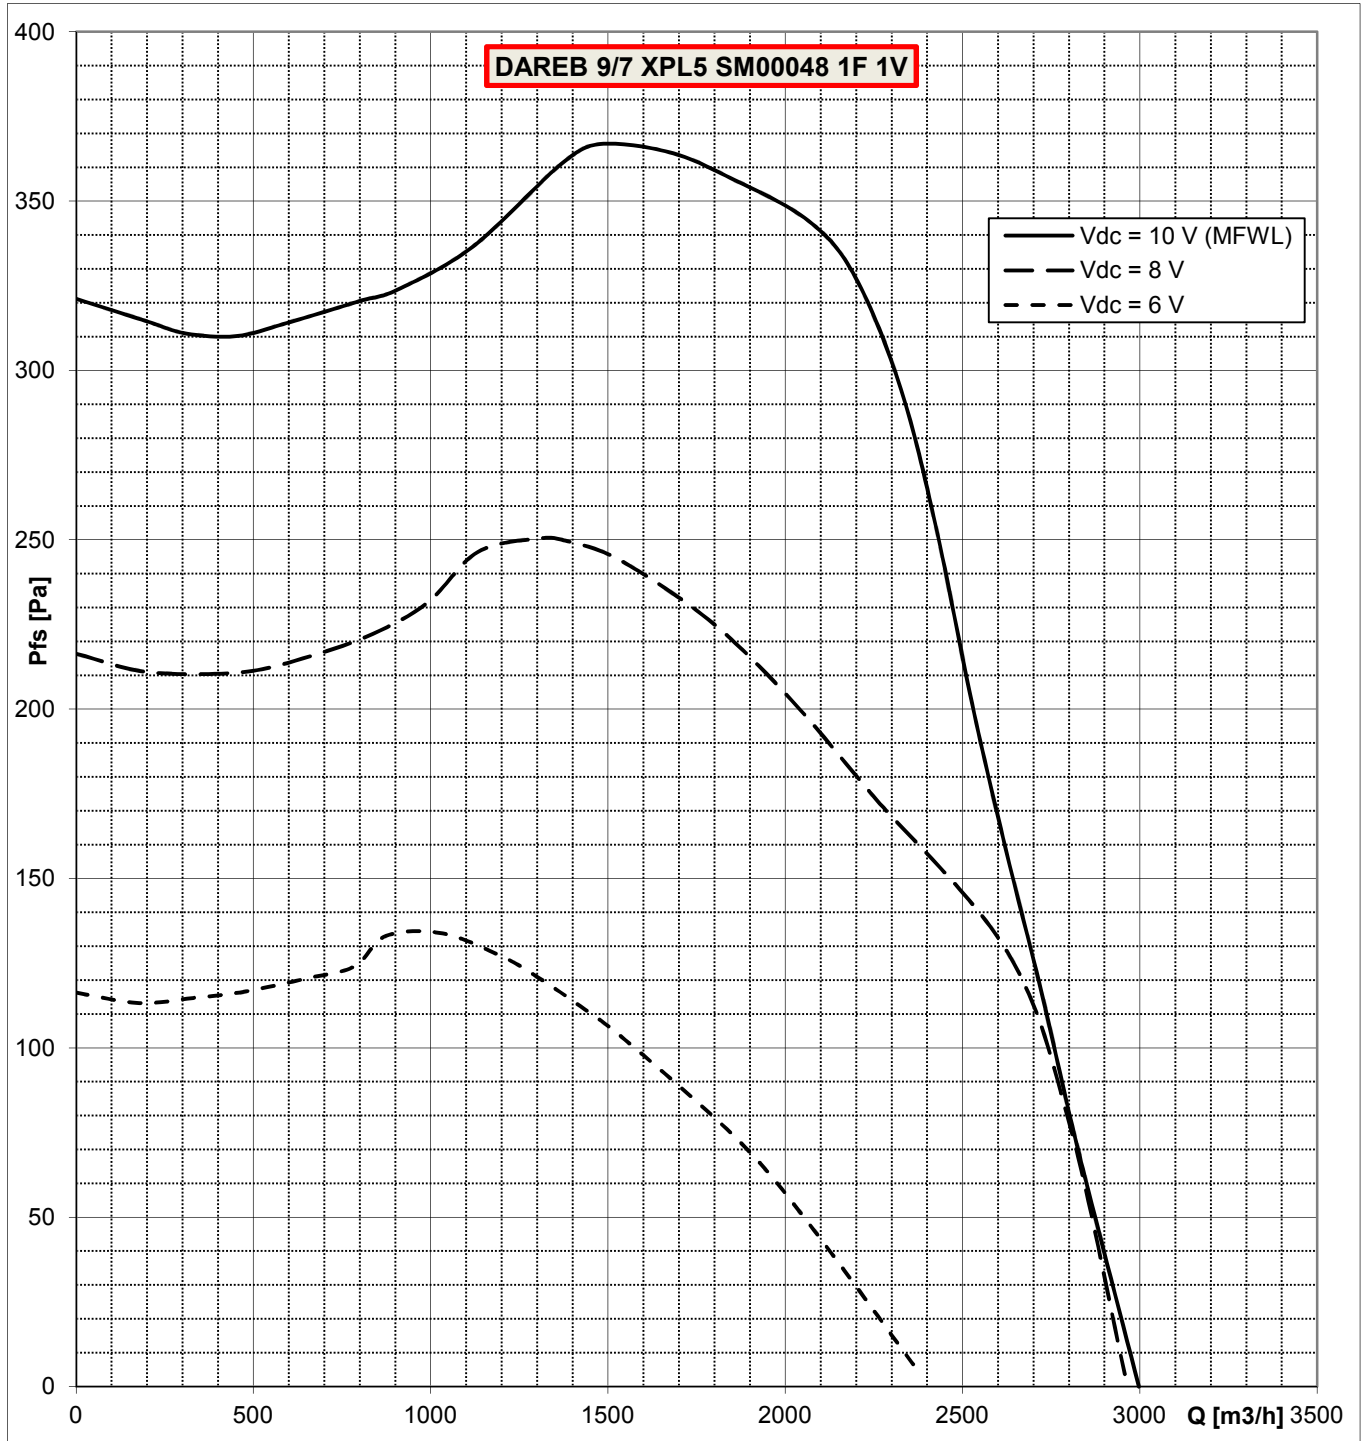

Data are not certified by AMCA