

Air density (γ): 1.20 kg/m³


Installation type "B": free inlet, ducted outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12

Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type:	MCK 10/10 XPL	Motor code:	MTR.4P.550.1V	Motor T.H.:	YES IN
Test nr.:	2205	Motor power [W]:	550	Capacitor [μF]:	12,5
Date:	2017/01/09	Motor poles:	4	Unit max. abs. current [A]:	5,6
Power supply[V]:	230 1~	Mot. prot. class:	IP44	Unit max. abs. power [W]:	1250
Frequency [Hz]:	50	Mot. ins. class:	F		

ErP status: ErP 2016

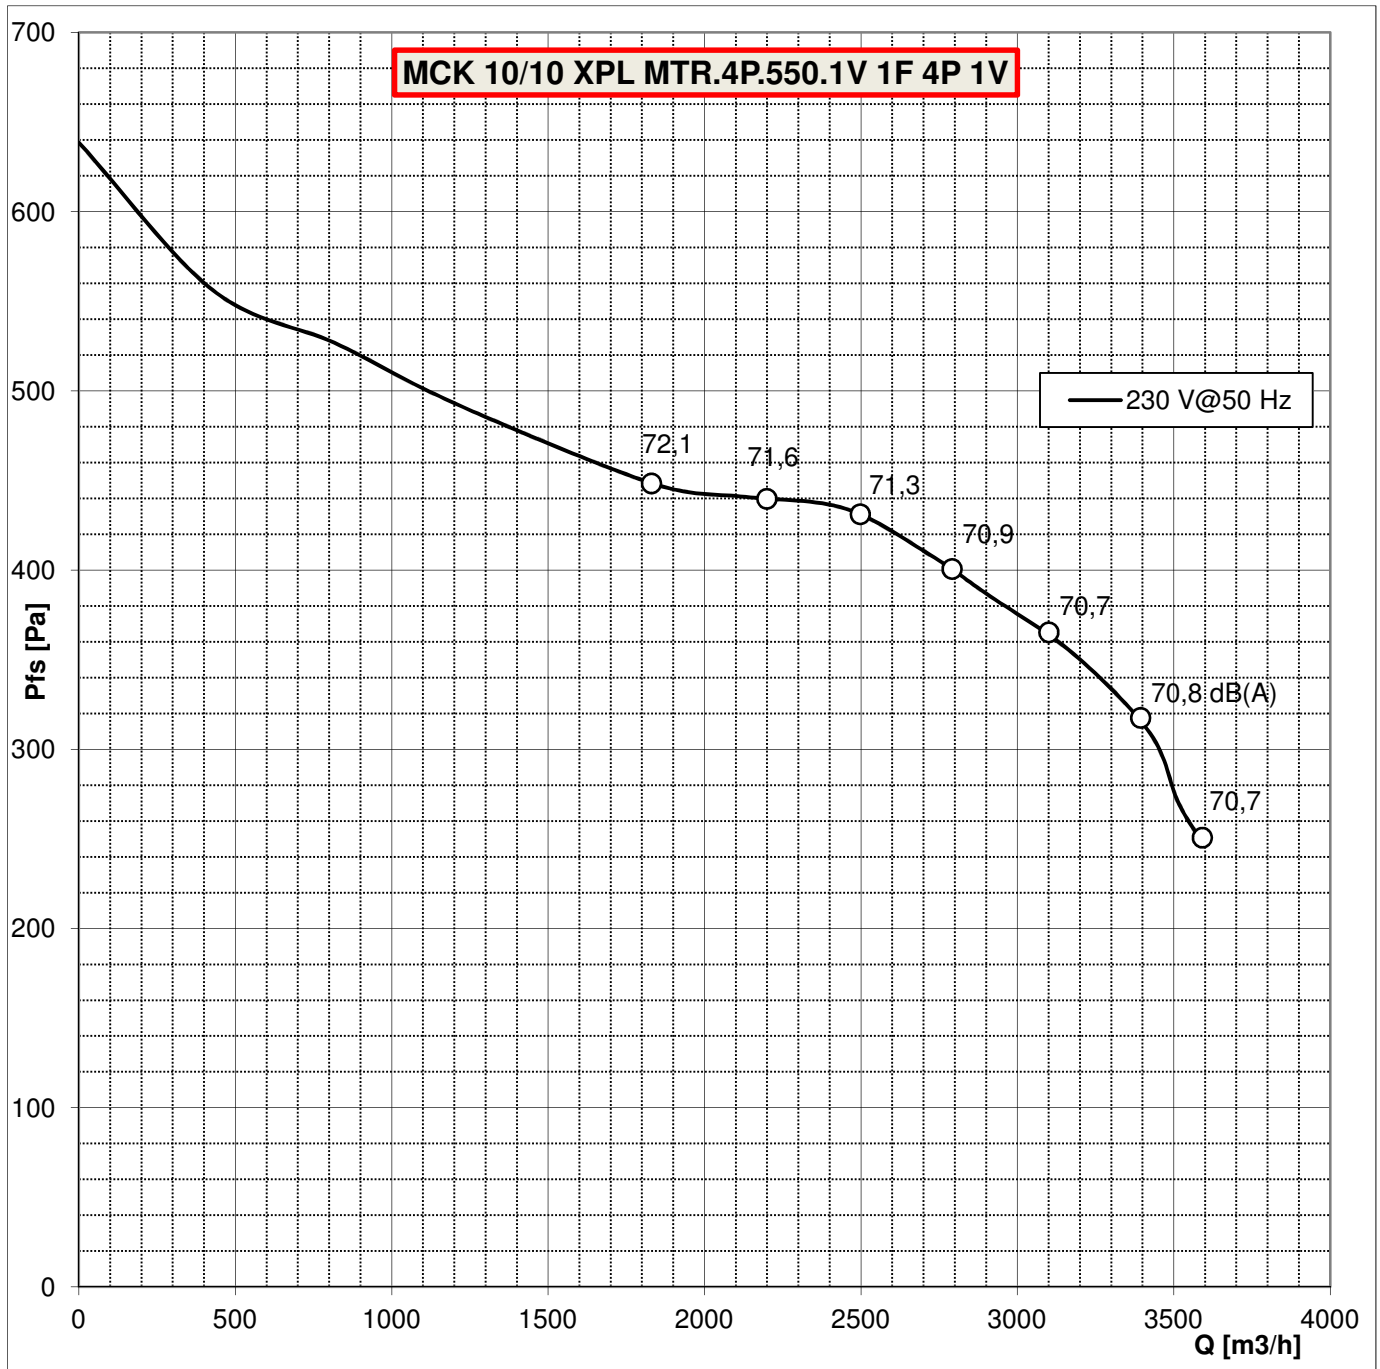

Data are not certified by AMCA