

Air density (γ): 1.20 kg/m³

Installation type "B": free inlet, ducted outlet

12000 m³/h fan test chamber according to AMCA 210/05 fig. 12


Free field Lp(A) measurements at 1 m according to ISO 3746:2011

Unit type: MCK 9/7 X18
 Test nr.: 2924
 Date: 2018/05/31
 Power supply[V]: 230 1~
 Frequency [Hz]: 50

Motor code: 2011017
 Motor power [W]: 420
 Motor poles: 4
 Mot. prot. class: IP55
 Mot. ins. class: F

Motor Th. Prot.: YES IN
 Capacitor [μ F]: 8
 Unit max. abs. current [A]: 3,3
 Unit max. abs. power [W]: 760

ErP status: ErP 2018

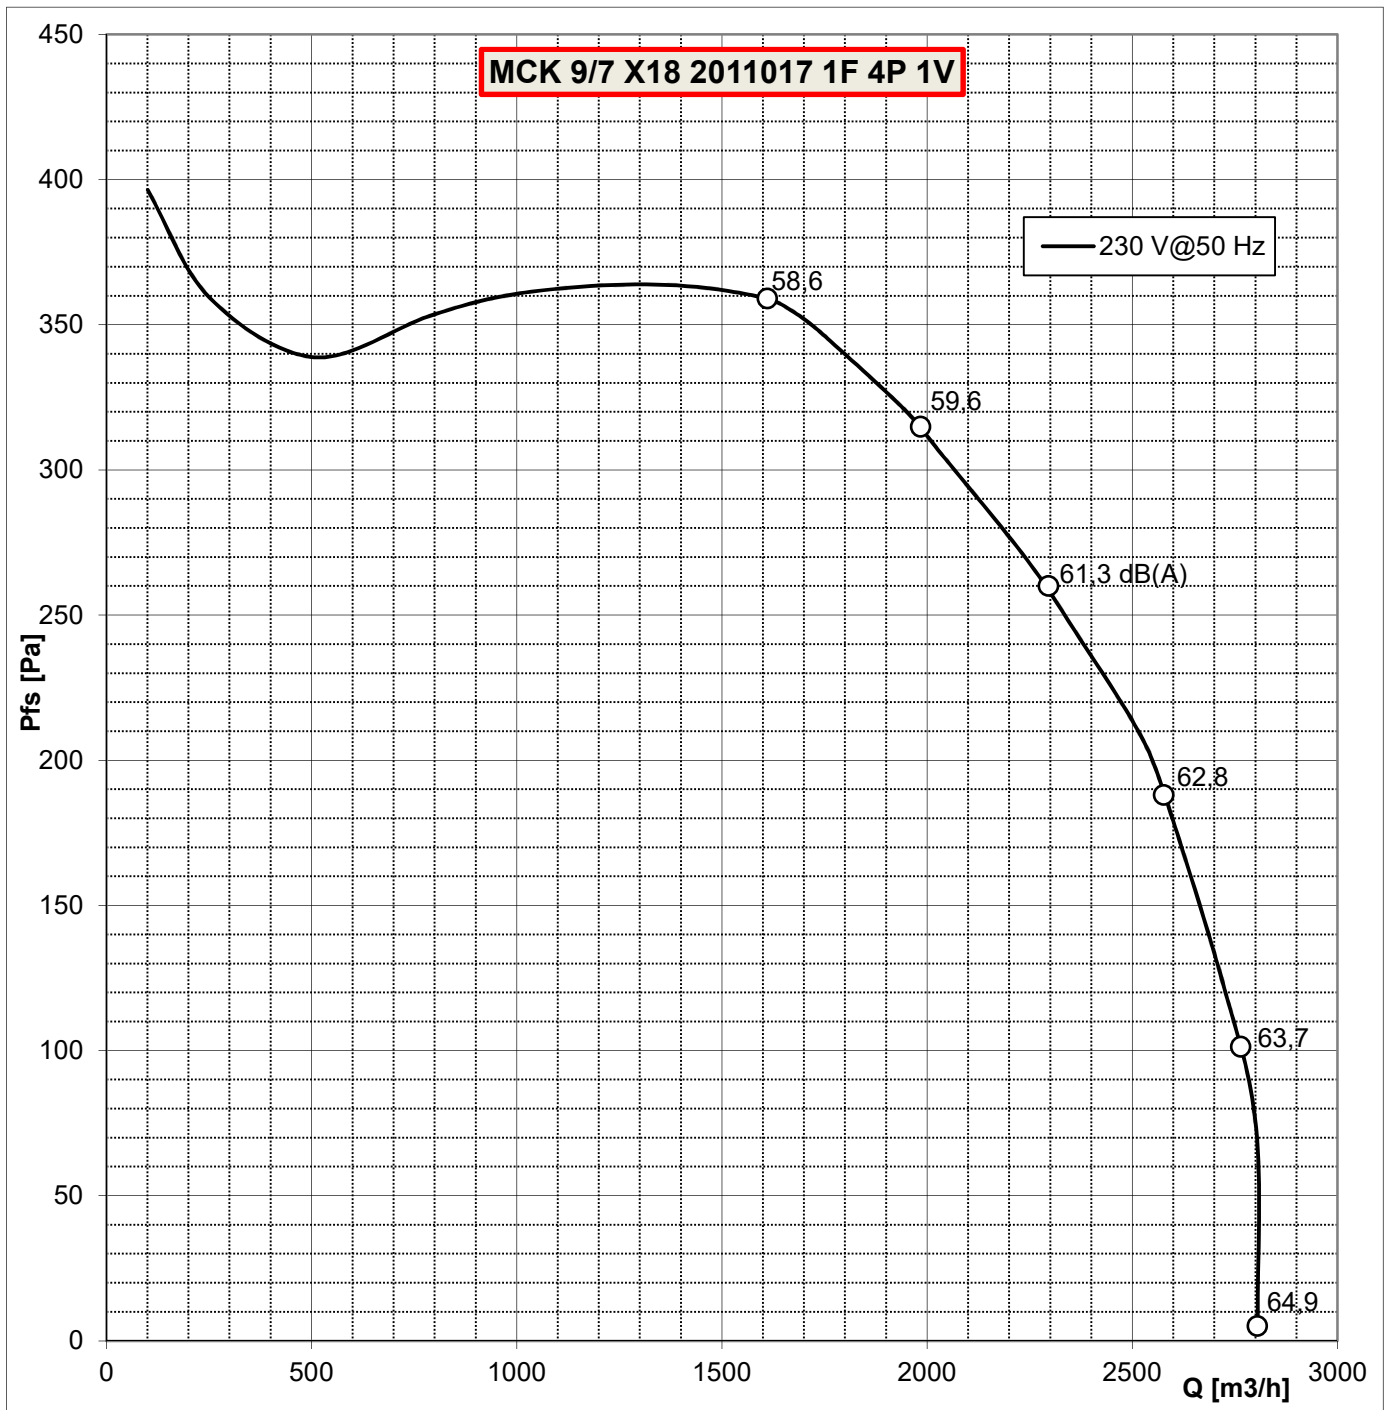

Data are not certified by AMCA