


Air density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 12000 m³/h fan test chamber according to AMCA 210/05 fig. 12
 Free-field Lp(A) measurements at 1 m according to ISO 3746:2011

Fan type:	MCK 12/12 X18	Motor code:	2011009	Motor T.H.:	YES IN
Test nr.:	2916	Motor power [W]:	560	Capacitor [μF]:	20
Date:	2018/05/29	Motor poles:	6	Fan max. abs. current [A]:	6,3
Power supply[V]:	230 1~	Mot. prot. class:	IP44	Fan max. abs. power [W]:	1390
Frequency [Hz]:	50	Mot. ins. class:	F		

Unit ErP status: ErP 2018

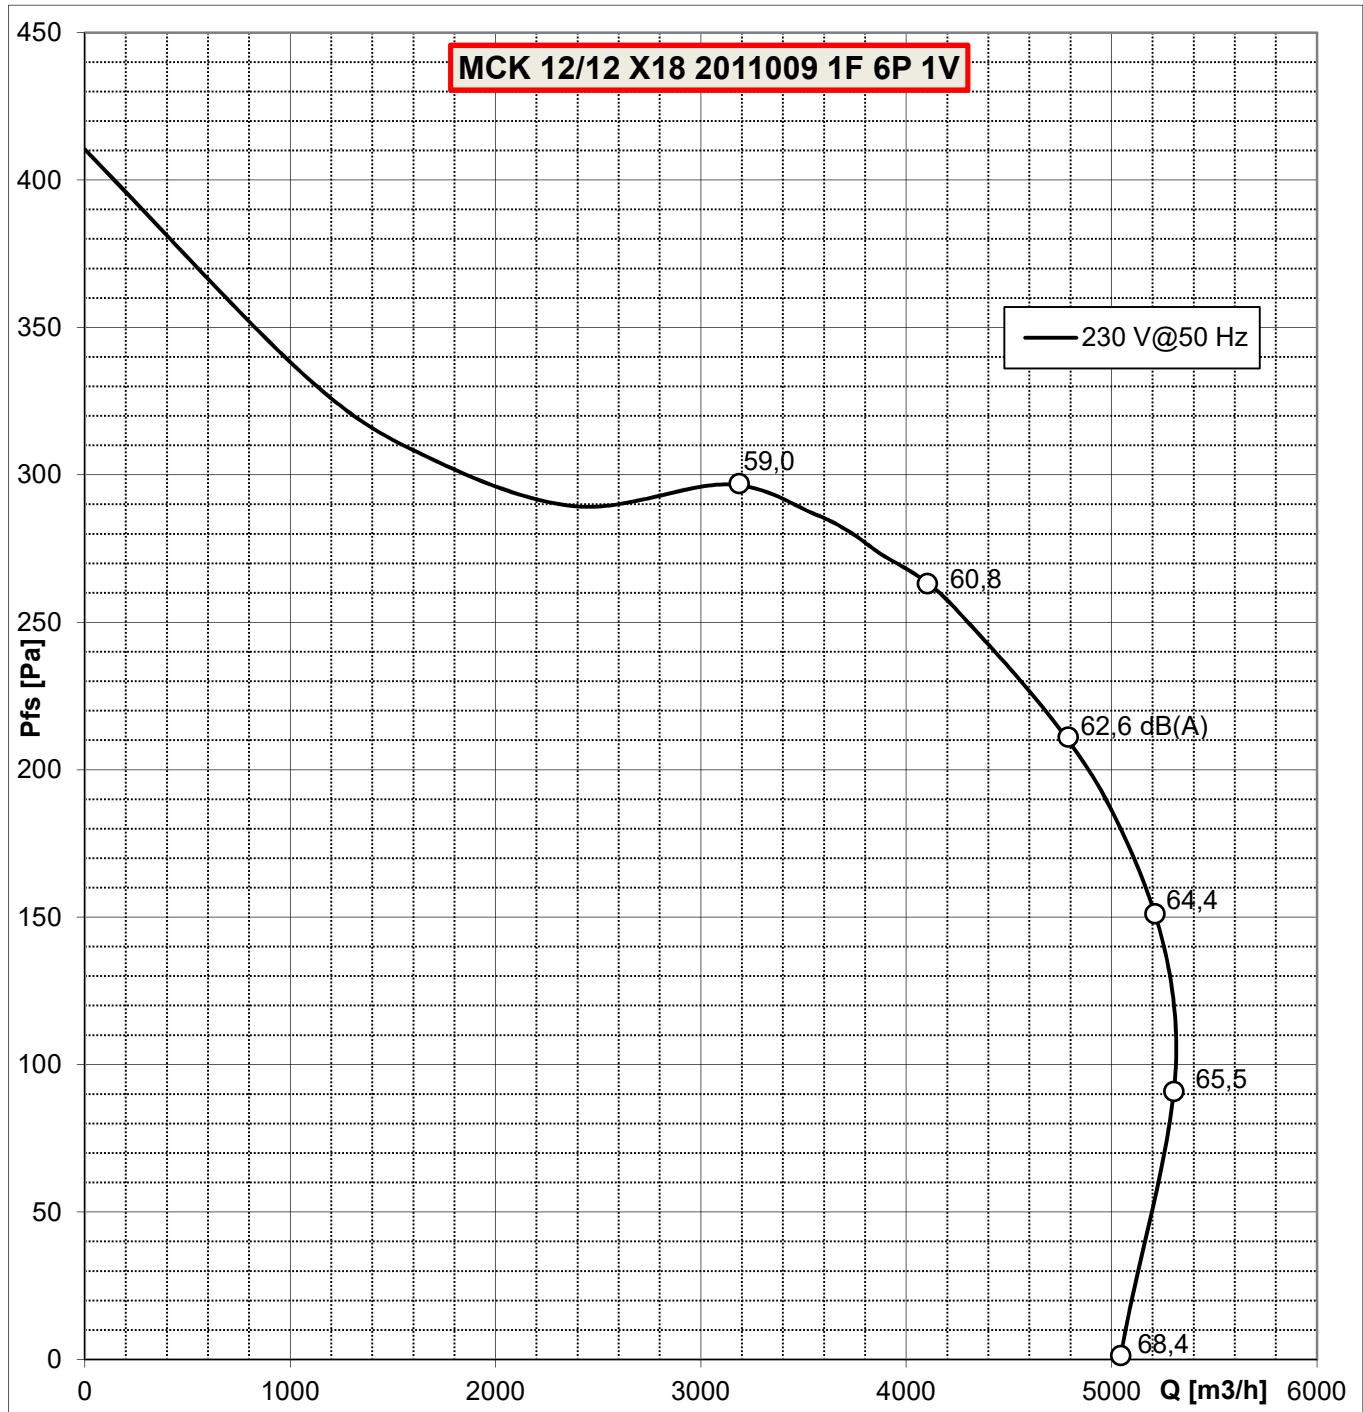

Data are not certified by AMCA