

Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>


Installation type "B": free inlet, ducted outlet

12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12

Free field Lp(A) measurements at 1 m according to ISO 3746:2011

<b>Fan type:</b>	MCK 12/12 XPL	<b>Motor code:</b>	2011008	<b>Motor T.H.:</b>	YES OUT
<b>Test nr.:</b>	1911	<b>Motor power [W]:</b>	1100	<b>Capacitor [<math>\mu</math>F]:</b>	-
<b>Date:</b>	2016/07/06	<b>Motor poles:</b>	6	<b>Max. abs. current [A]:</b>	4,26/7,38
<b>Power supply[V]:</b>	400/230 3~	<b>Mot. prot. class:</b>	IP20	<b>Max. abs. power [W]:</b>	2200
<b>Frequency [Hz]:</b>	50	<b>Mot. ins. class:</b>	F		

ErP status: ErP 2016

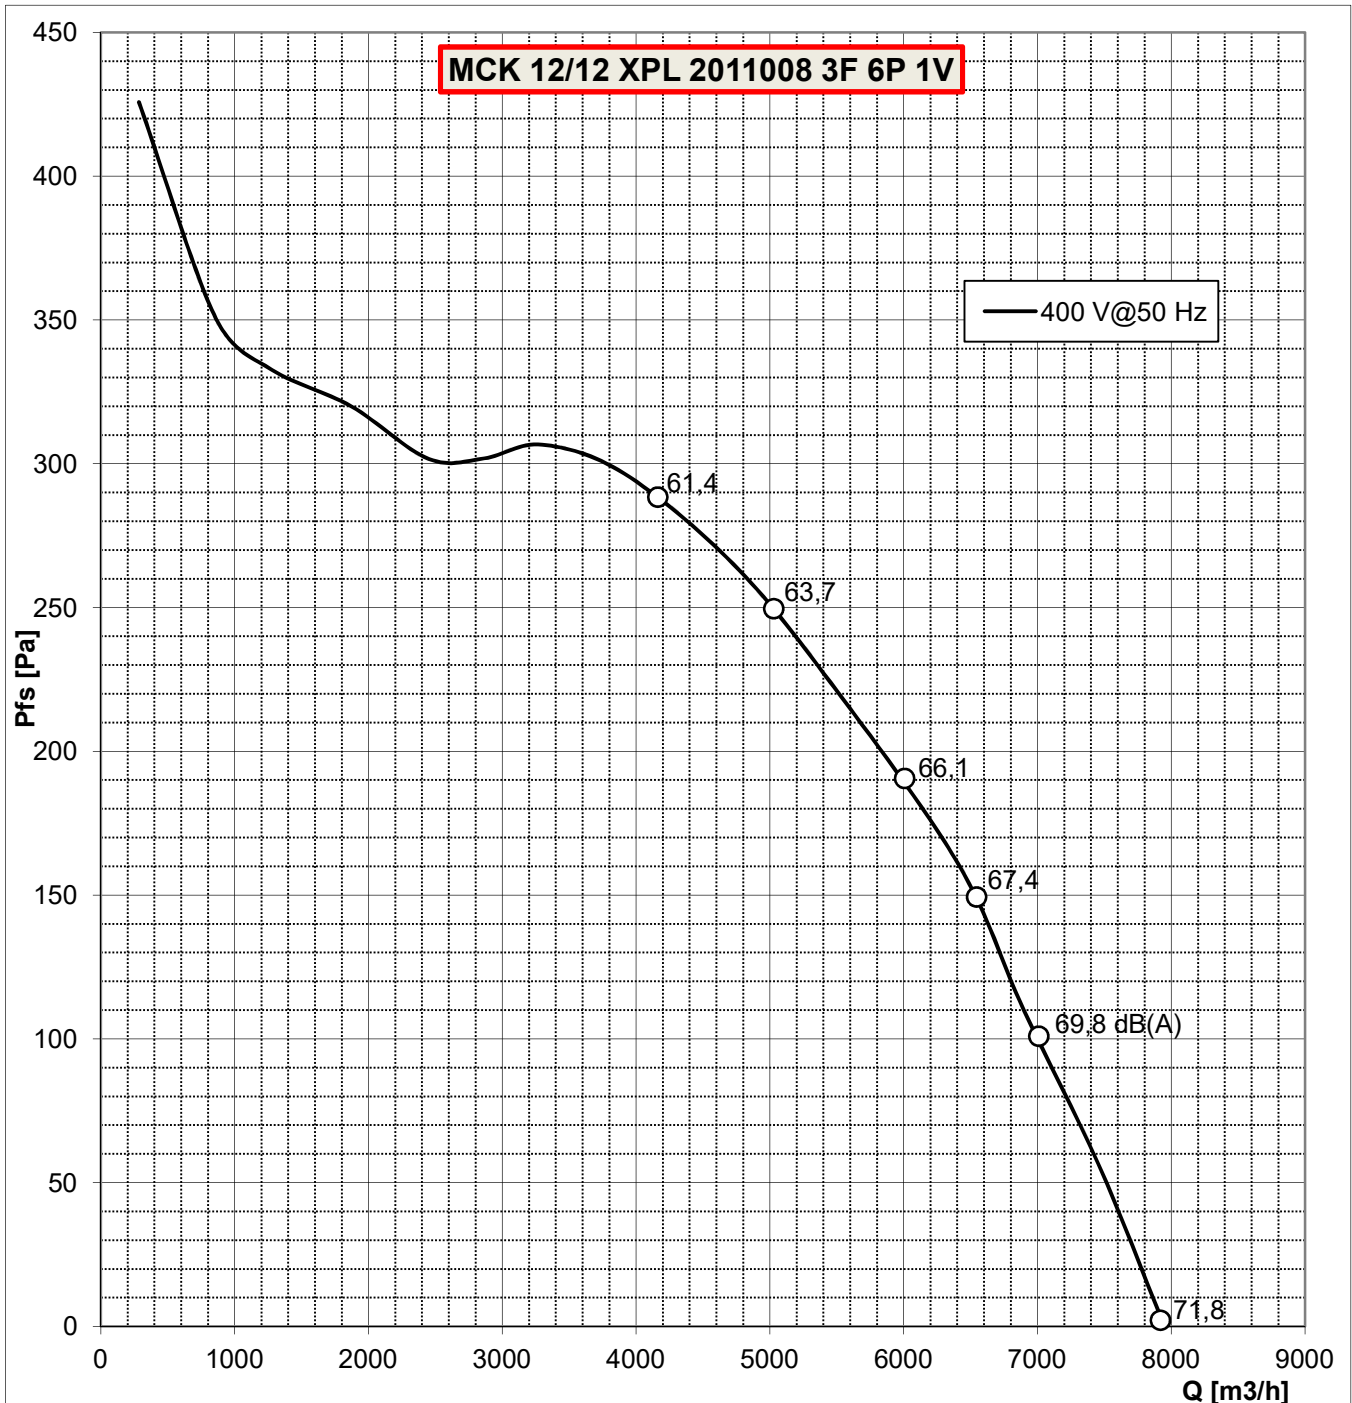

Data are not certified by AMCA