


Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>  
 Installation type "A": free inlet, free outlet  
 12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12

**Fan type:** RFB 280/50  
**Test nr.:** 1659,1660,1661,1662  
**Date:** 2016/02/01  
**Power supply[V]:** 230 1~  
**Frequency [Hz]:** 50

**Motor code:** SM00070  
**Motor power [W]:** 270 (Win)  
**Motor poles:** -  
**Mot. prot. class:** IP30  
**Mot. ins. class:** F

**Motor T.H.:** SW alarm  
**Capacitor [ $\mu$ F]:** -  
**Fan max. abs. current [A]:** 1.86

**Fan ErP status:** ErP 2015

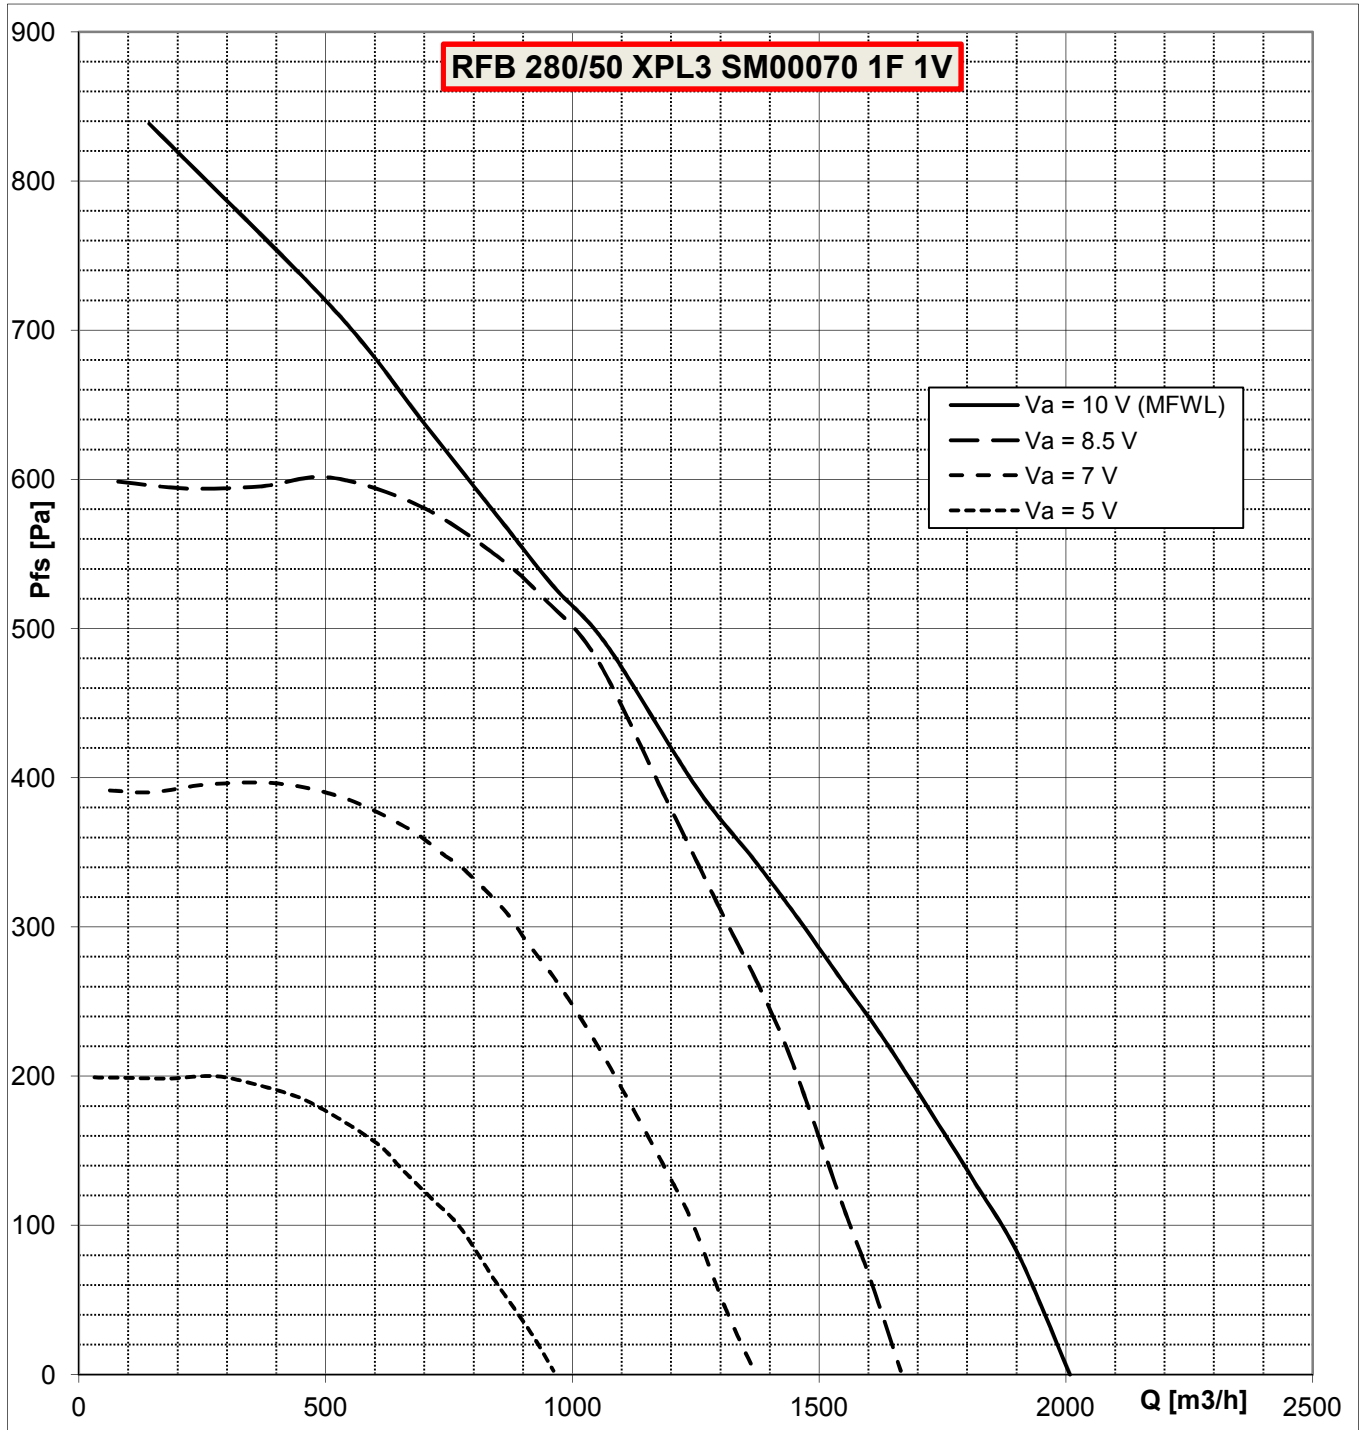

Data are not certified by AMCA