


Air density ( $\gamma$ ): 1.20 kg/m<sup>3</sup>

Installation type "A": free inlet, free outlet

12000 m<sup>3</sup>/h fan test chamber according to AMCA 210/05 fig. 12

<b>Fan type:</b>	SARE 200/100 XPL	<b>Motor code:</b>	2111001	<b>Motor T.H.:</b>	YES IN
<b>Test nr.:</b>	1080, 1082 - 1084	<b>Motor power [W]:</b>	70	<b>Capacitor [<math>\mu</math>F]:</b>	2,5
<b>Date:</b>	2015/02/02	<b>Motor poles:</b>	4	<b>Fan max. abs. current [A]:</b>	0,9
<b>Power supply[V]:</b>	230 1~	<b>Mot. prot. class:</b>	IP44		
<b>Frequency [Hz]:</b>	50	<b>Mot. ins. class:</b>	F		

**Fan ErP status:** Not subjected to ErP Regulation (Pe < 125 W)

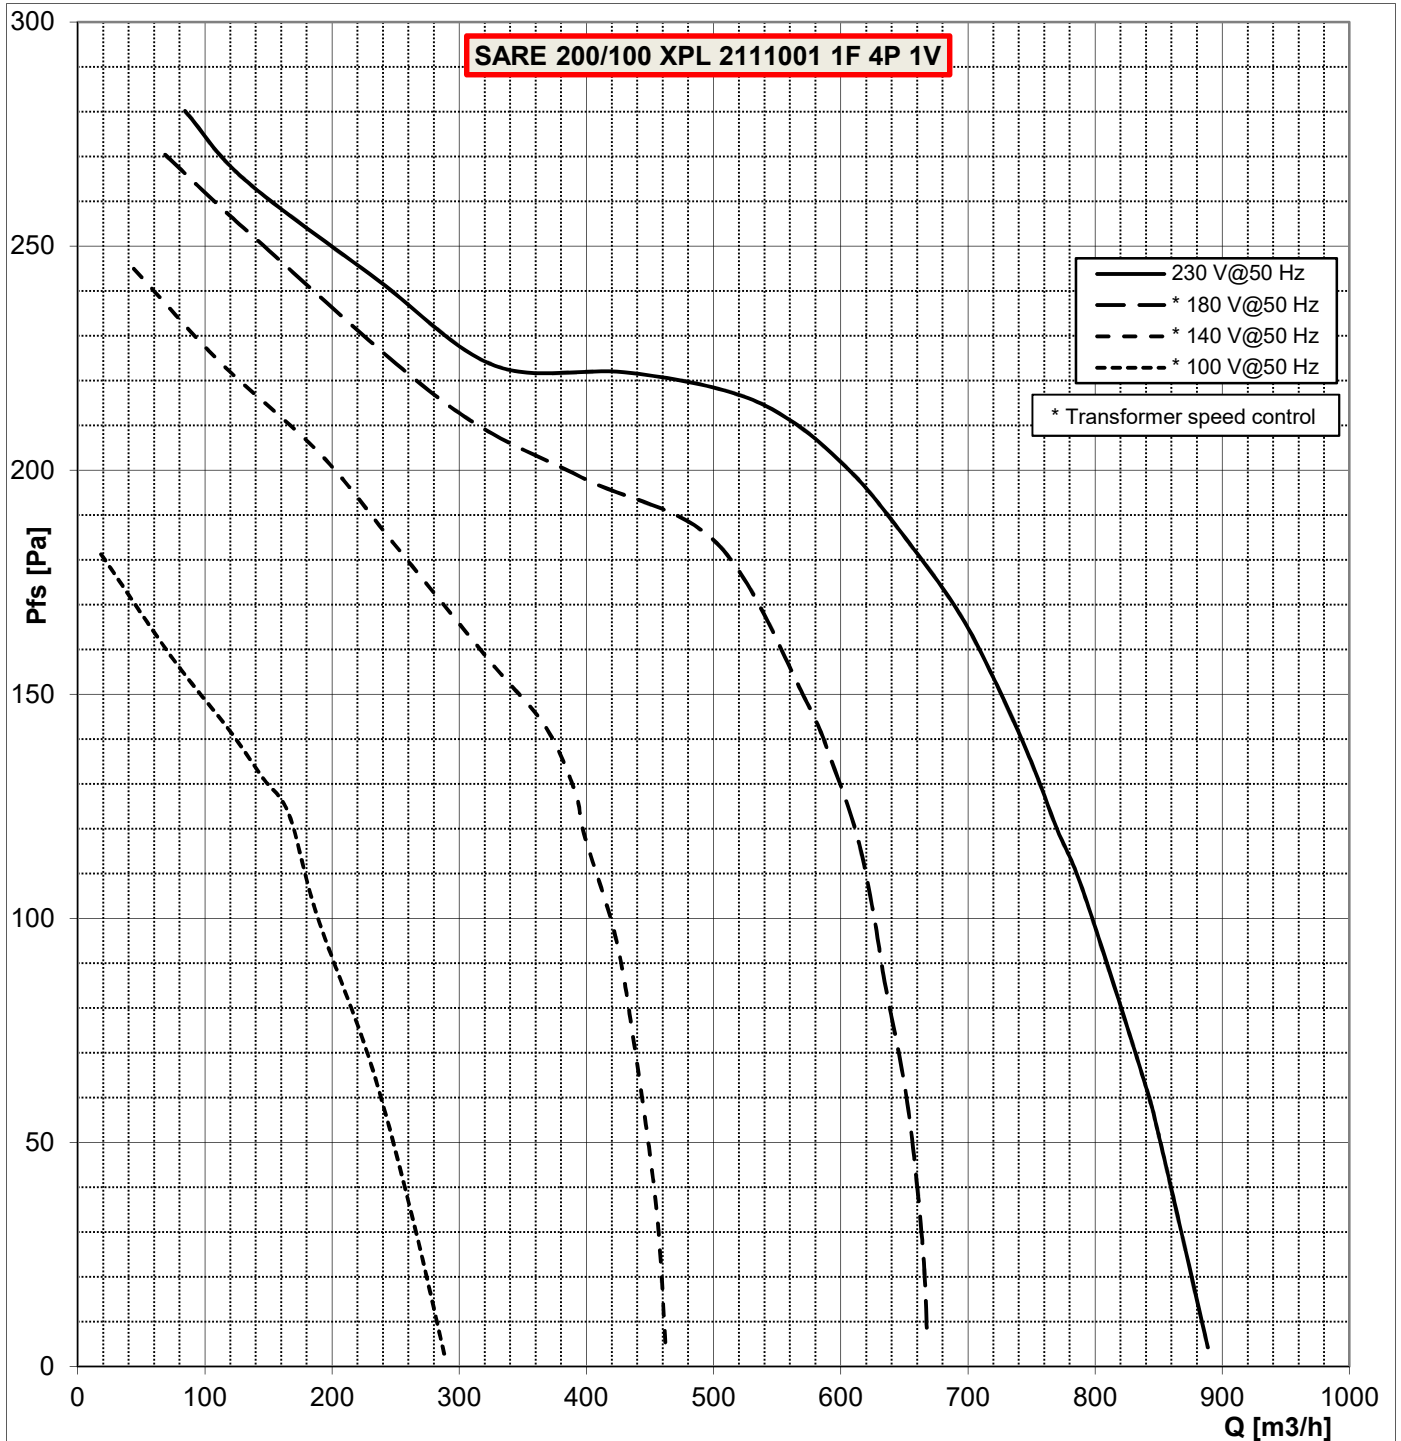

Data are not certified by AMCA